

Compatible with VS & VM control systems

A D D R E S S I N G

## Technology that saves lives

# Manual Pull Stations

GSA-M270, GSA-M270P, GSA-M278



## Overview

The GSA-M270 and GSA-M278 series Manual Pull Stations are part of Kidde's Signature Series system. The GSA-M270 Fire Alarm Manual Pull Stations feature our very familiar teardrop shape. They are made from die-cast zinc and finished with red epoxy powder-coat paint complemented by aluminum colored stripes and markings. With positive pull-lever operation, one pull on the station handle breaks the glass rod and turns in a positive alarm, ensuring protection plus fool-proof operation. Presignal models (GSA-M270P) are equipped with a general alarm (GA) keyswitch for applications where two stage operation is required. The up-front highly visible glass rod discourages tampering, but is not required for proper operation.

Kidde's double action single stage GSA-M278 station is a contemporary style manual station made from durable red colored lexan. To initiate an alarm, first lift the upper door marked "LIFT THEN PULL HANDLE", then pull the alarm handle.

## Standard Features

**Note:** Some features described here may not be supported by all control systems. Check your control panel's Installation and Operation Guide for details.

- Traditional familiar appearance
   GSA-M270 models feature our familiar teardrop design with
- One stage (GA), two stage (pre-signal), and double action models

simple positive pull action and sturdy die-cast metal body.

GSA-M270 models are available for one or two stage alarm systems. The single stage double action GSA-M278 features a rugged Lexan housing with keyed reset mechanism.

#### Break glass operation

An up-front visible glass rod on the GSA-M270 discourages tampering.

### Intelligent device with integral microprocessor

All decisions are made at the station allowing lower communication speed while substantially improving control panel response time. Less sensitive to line noise and loop wiring properties; twisted or shielded wire is not required.

#### ADA Compliant

Meets ADA requirements for manual pull stations.

#### • Electronic Addressing with Non-volatile memory

Permanently stores programmable address, serial number, type of device, and job number. Automatically updates historic information including hours of operation, last maintenance date, number of alarms and troubles, and time and date of last alarm.

#### Automatic device mapping

Each station transmits wiring information to the loop controller regarding its location with respect to other devices on the circuit.

#### • Stand-alone operation

The station inputs an alarm even if the loop controller's polling interrogation stops.

## Diagnostic LEDs

Status LEDs; flashing GREEN shows normal polling; flashing RED shows alarm state.

 Designed for high ambient temperature operation Install in ambient temperatures up to 120 °F (49 °C).

## **Application**

The operating characteristics of the fire alarm stations are determined by their sub-type code or "Personality Code". NORMALLY-OPEN ALARM - LATCHING (Pesonality Code 1) is assigned by the factory; no user configuration is required. The device is configured for Class B IDC operation. An ALARM signal is sent to the loop controller when the station's pull lever is operated. The alarm condition is latched at the station.

## Compatibility

Signature Series manual stations are compatible only with Kidde's Signature Loop Controller.

## Warnings & Cautions

This device will not operate without electrical power. As fires frequently cause power interruption, we suggest you discuss further safeguards with your local fire protection specialist.

## Testing & Maintenance

To test (or reset) the station simply open the station and operate the exposed switch. The GSA-M270 series are opened with a tool; the GSA-M278 requires the key which is supplied with that station.

The station's automatic self-diagnosis identifies when it is defective and causes a trouble message. The user-friendly maintenance program shows the current state of each Signature series device and other pertinent messages. Single devices may be deactivated temporarily, from the control panel. Availability of maintenance features is dependent on the fire alarm system used.

Scheduled maintenance (Regular or Selected) for proper system operation should be planned to meet the requirements of the Authority Having Jurisdiction (AHJ). Refer to current NFPA 72 and ULC CAN/ULC 536 standards.

## Typical Wiring

The fire alarm station's terminal block accepts #18 AWG (0.75mm²) to #12 AWG (2.5mm²) wire sizes. See Signature Loop Controller catalog sheet for detailed wiring requirement specifications.

#### **Wiring Notes**

- Refer to Signature Loop Controller manual for maximum wire distance.
- 2. All wiring is power limited and supervised.




Figure 4. Single Stage Systems

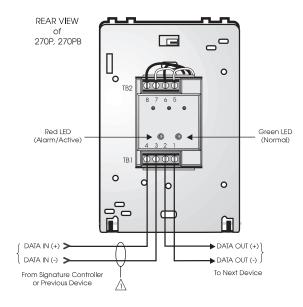


Figure 5. Two Stage Systems

## Installation

Single-stage Signature Series fire alarm manual pull stations mount to North American 2½ inch (64 mm) deep 1-gang boxes.

Two stage presignal (270P) models require 1½ inch (38 mm) deep 4-inch square boxes with 1-gang, ½-inch raised covers. Openings must be angular. *Rounded openings are not acceptable*. Recommended box: Steel City Model 52-C-13; in Canada, use Iberville Model CI-52-C-49-1/2.

**All models** include terminals are suited for #12 to #18 AWG (2.5 mm² to 0.75 mm²) wire size. Kidde recommends that these fire alarm stations be installed according to latest recognized edition of national and local fire alarm codes.

**Electronic Addressing:** The loop controller electronically addresses each manual station, saving valuable time during system commissioning. Setting complicated switches or dials is not required. Each station has its own unique serial number stored in its on-board memory. The loop controller identifies each device on the loop and assigns a "soft" address to each serial number. If desired, the stations can be addressed using the SIGA-PRO Signature Program/Service Tool.

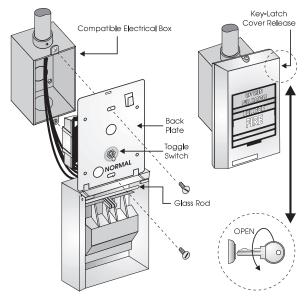


Figure 1. GSA-M278 installation

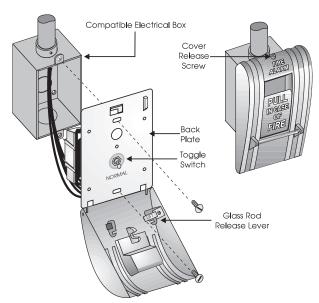


Figure 2. GSA-M270 installation

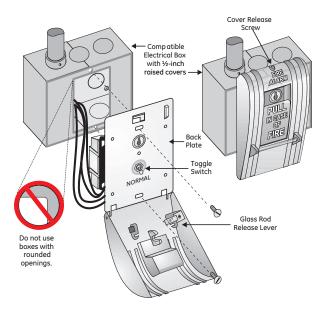


Figure 3. GSA-M270P installation



#### Technology that saves lives

#### Contact us...

Email: kidde.fire@fs.utc.com
Web: kidde.com/engineeredsystems

1016 Corporate Park Drive Mebane, NC 27302

Kidde is a registered mark in the United States and other countries.

© 2018 Walter Kidde Portable Equipment. All rights reserved.

# Specifications

Catalog Number	GSA-M270	GSA-M270P,	GSA-M278	
Description	Single Action - One Stage	Single Action -Two Stage (Presignal)	Double Action - One Stage	
Addressing Requirements	Uses 1 Module Address	Uses 2 Module Addresses	Uses 1 Module Address	
Operating Current	Standby = 250µA Activated = 400µA	Standby = 396µA Activated = 680µA	Standby = 250µA Activated = 400µA	
Construction & Finish		Diecast Zinc - Red Epoxy with aluminum markings		
Type Code	Factory Set			
Operating Voltage	15.2 to 19.95 Vdc (19 Vdc nominal)			
Storage and Operating Environment	Operating Temperature: 32°F to 120°F (0°C to 49°C) Storage Temperature: -4°F to 140°F (-20°C to 60°C) Humidity: 0 to 93% RH			
LED Operation	On-board Green LED - Flashes when polled On-board Red LED - Flashes w hen in alarm			
Compatibility	Use With: Signature Loop Controller			
Agency Listings	UL, ULC, MEA, CSFM, FM			

## Ordering Information

Catalog Number	Description	Ship Wt. lbs (kg)
GSA-M270	One Stage Fire Alarm Station, English Markings - UL/ULC Listed	
GSA-M270P	GSA-M270P Two Stage (Presignal) Fire Alarm Station, English Markings - UL/ULC Listed	
GSA-M278	SA-M278 Double Action (One Stage) Fire Alarm Station, English Markings - UL/ULC Listed	
Accessories		
270-GLR	20 Glass Rods - for GSA-M270 series (USA ONLY)	
276-GLR	20 Glass Rods - for GSA-M278 series	