


INSTALLATION



NOTES:

- * 1. **DIMENSIONS IN PARENTHESIS** ARE FOR LONG WIRE TRANSFER DEVICE (180°) ONLY.
- 2. FOR **WOOD DOOR** THE 10.28 X 1.0 CUTOUT IS 2" DEEP MIN.
- 2. USE HOUSING AS DRILLING TEMPLATE.
- 3. TRANSFER IS DESIGNED TO PROTECT THE WIRE. CARE SHOULD ALSO BE TAKEN WHEN INSERTING WIRES THROUGH THIS DEVICE.
- 5. ONLY STRANDED WIRES TO BE EMPLOYED.
- 6. SIZE AND NUMBER OF WIRES MUST COMPLY WITH THE NATIONAL ELECTRICAL CODE, NFPA AND LOCAL AUTHORITIES HAVING JURISDICTION. WIRE SIZE SHALL BE AT LEAST 22 GAUGE
- 7. THIS DEVICE IS INTENDED FOR LOW VOLTAGE USE ONLY (30 VAC, 42.5 VDC, 10 W MAX).
- 8. WIRE SHOULD BE LABELED, APPLIANCE WIRING MATERIAL WITH MINIMUM 1/32" THICK INSULATION.
- 9. FOR WOOD DOOR $\text{Ø}.69$ IS .75" DEEP MIN.

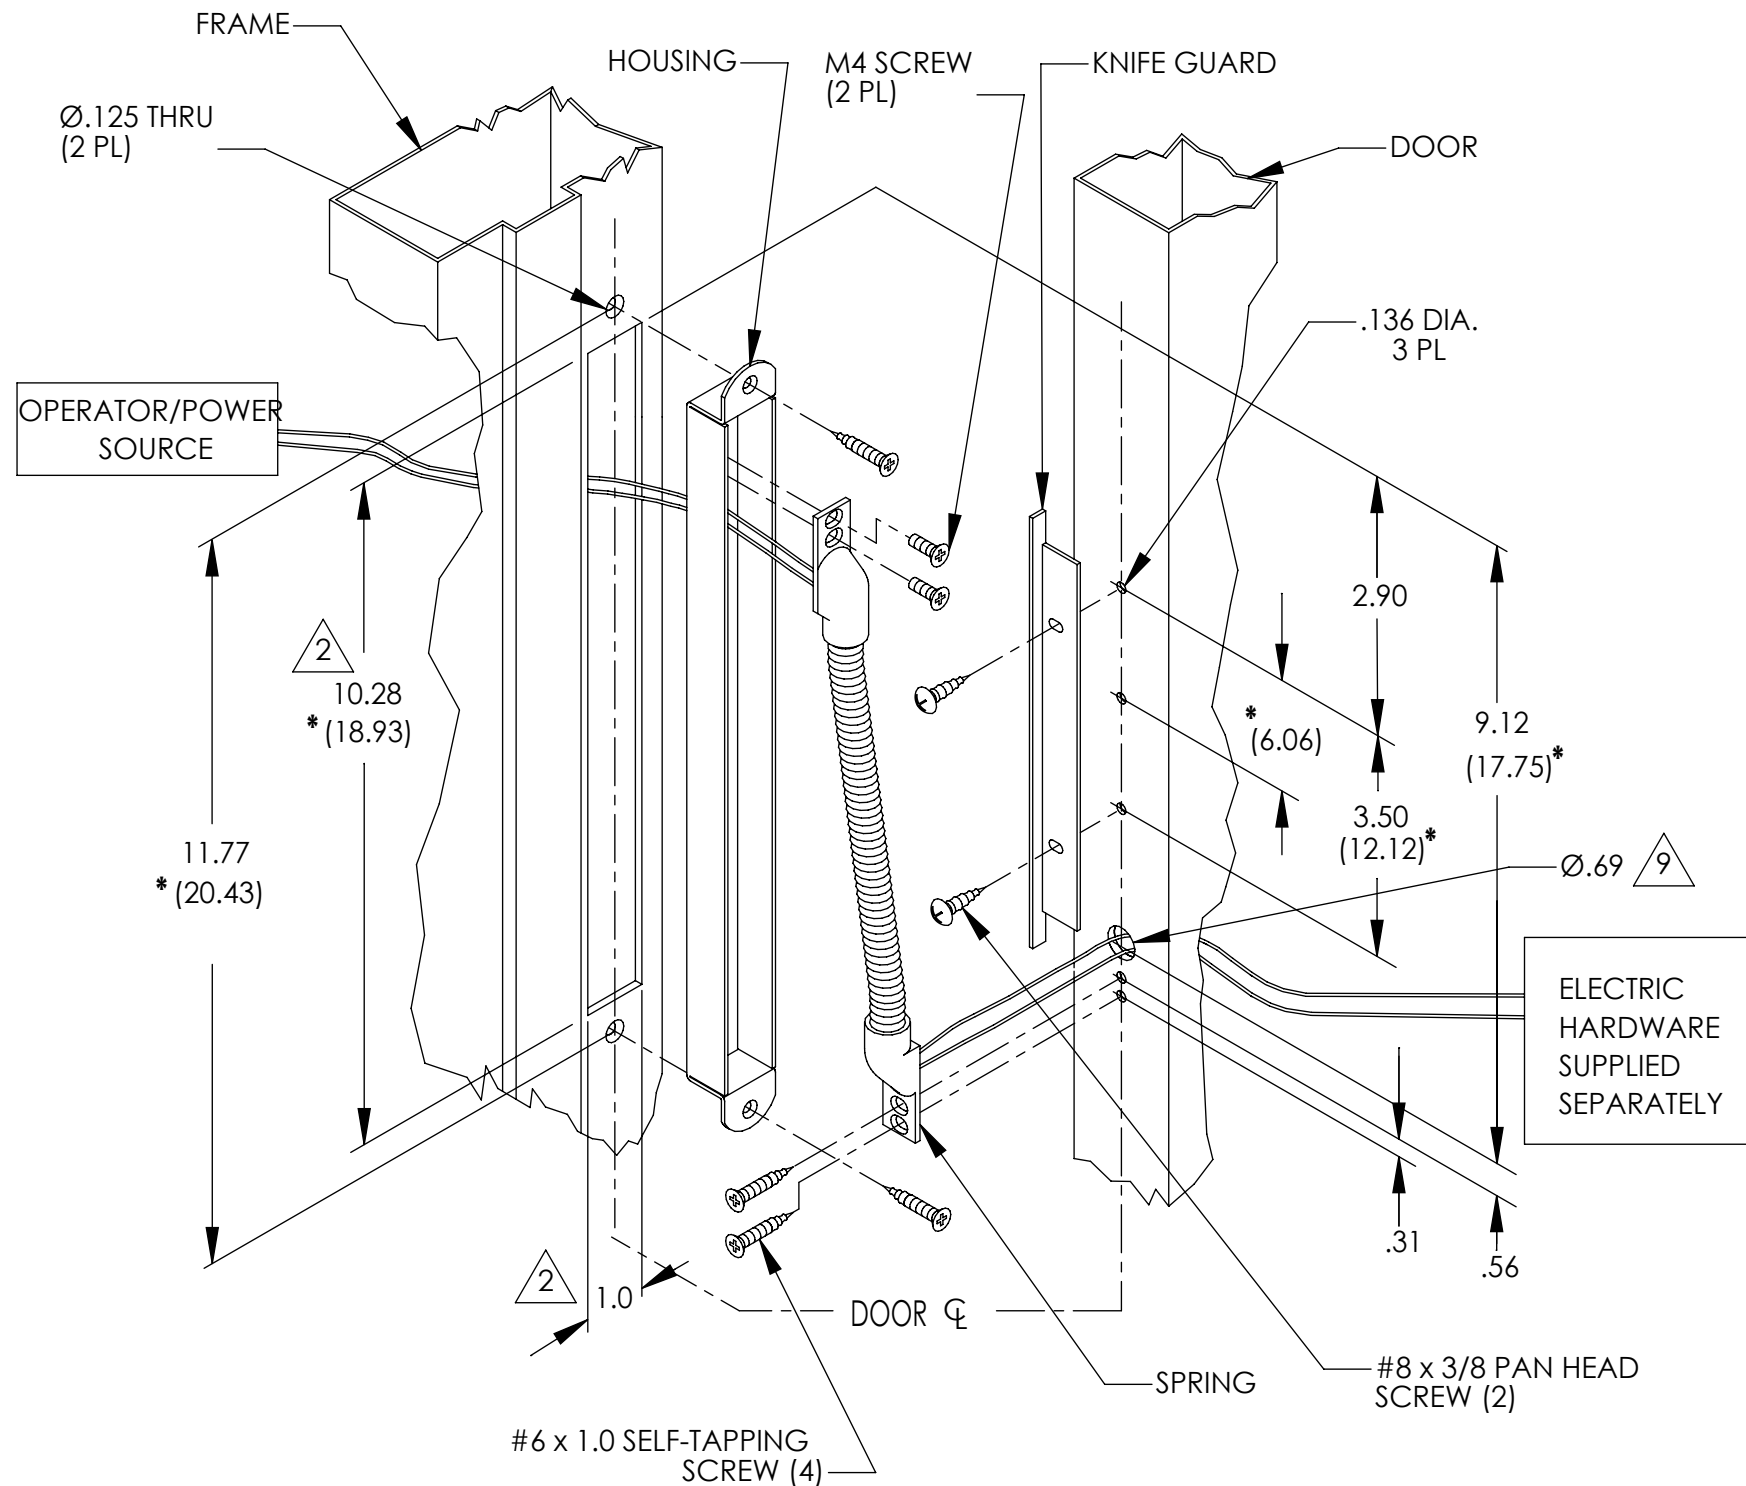

ASSA ABLOY

www.adamsrite.com
Phone: 800-626-7590
800-872-3267
Fax: 866-582-4641
800-232-7329

4612 WIRE TRANSFER DEVICE
80-0180-100 Rev. G 11955A

PRODUCT MUST BE INSTALLED
ACCORDING TO ALL APPLICABLE
BUILDING AND LIFE SAFETY CODES

INSTALLATION INSTRUCTIONS

Page 1 of 1 Appvd: MP Date: 06-18-12