

## Altronix/CDVI Kits

### Models Include:

#### T1CVK34

4 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove1 enclosure with TC1 Altronix/CDVI backplane
- One (1) AL600ULXB - Power Supply/Charger
- One (1) ACM4 - Fused Access Power Controller

#### T2CVK710

10 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove2 enclosure with TCV2 Altronix/CDVI backplane
- One (1) AL1024ULXB2 - Power Supply/Charger
- One (1) ACM8 - Fused Access Control Module
- One (1) ACM4 - Fused Access Control Module
- One (1) PD8UL - Fused Power Distribution Module

#### T2CVK3310

10 Door Kit with PTC Outputs

Fully assembled kit includes:

- Trove2 enclosure with TCV2 Altronix/CDVI backplane
- Two (2) AL600ULXB - Power Supply/Chargers
- Two (2) MOM5 - PTC Power Distribution Modules with Fire Alarm Interface

#### T3CVK7720

20 Door Kit with Fused Outputs

Fully assembled kit includes:

- Trove3 enclosure with TCV3 Altronix/CDVI backplane
- Two (2) AL1024ULXB2 - Power Supply/Chargers
- Two (2) ACM8 - Fused Access Control Modules
- One (1) ACM4 - Fused Access Control Module
- One (1) PD8UL - Fused Power Distribution Module
- One (1) RSB2 - Rocker Switch Bracket with Two (2) Rocker Switches (Not evaluated by UL)

All components of this Trove kit are UL Listed sub-assemblies.

Please refer to the included corresponding Sub-Assembly Installation Guides for further information.

## Installation Guide



More than just power.™

All registered trademarks are property of their respective owners.

Rev. TCVLK\_042922

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address: \_\_\_\_\_ Phone #: \_\_\_\_\_

## Overview:

Altronix Trove CDVI kits are pre-assembled and consist of Trove enclosures/backplanes with factory installed Altronix power supply/chargers and sub-assemblies. These kits also accommodate various combinations of CDVI Atrium A22K/A22NB/ADH10 boards for up to twenty (20) doors in a single enclosure.


## Configuration Chart:

Altronix Model Number	115VAC 60Hz Input Current (A)	Power Supply Board Input Fuse Rating	Power Supply Board Battery Fuse Rating	Maximum Supply Current for Main Outputs on Power Supply board, MOM5 power distribution module or ACM4/ACM8 Access Power Controllers' outputs	Nominal DC Output Voltage Power Supply Output Range (VDC)	Fail-Safe/ Fail-Secure or Dry Form "C" Outputs	Additional Fuse or PTC Protected Outputs	ACM4/ ACM8 Board Input Fuse Rating	ACM4 Board Output Fuse Rating	ACM8 Board Output Fuse Rating	PD8UL Board Output Fuse Rating	MOM5 Output PTC Rating
T1CVK34	3.5	5A/ 250V	–	24VDC @ 5.7A	20.17-26.4	4	–	10A/ 32V	3A/ 32V	–	–	–
T2CVK710	4.5		15A/ 32V	24VDC @ 9.4A	20.17-26.4	12	8	10A/ 250V	3A/ 32V	2.5A/ 250V	3.5A/ 250V	–
T2CVK3310	7.0		–	24VDC @ 5.9A + 24VDC @ 5.9A	20.17-26.4	–	10	–	–	–	–	2.5A
T3CVK7720	8.4		15A/ 32V	24VDC @ 9.4A + 24VDC @ 9.7A	20.17-26.4 9.7-13.2	20	8	10A/ 250V	3A/ 32V	2.5A/ 250V	3.5A/ 250V	–

## Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

- Remove backplane from enclosure. Do not discard hardware.  
**If your application requires a raised backplane, re-mount it using metal spacers and screws (provided).**
- Mark and predrill holes in the wall to line up with the top three keyholes in the enclosure. Install two/three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two/three upper screws; level and secure. Mark the position of the lower two/three holes. Remove the enclosure. Drill the lower holes and install the fasteners. Place the enclosure's upper keyholes over the upper screws. Install the lower screws and make sure to tighten all screws.
- Mount included UL Listed tamper switch(es) (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
- Mount CDVI A22K/A22NB/ADH10 boards to backplane, *refer to pages 3-6*.
- Refer to the *ULXB Power Supply/Charger Installation Guide* (AL600ULXB, AL1024ULXB) and corresponding *Sub-Assembly Installation Guide* (ACM4, ACM8, PD8UL, MOM5) for further installation instructions.

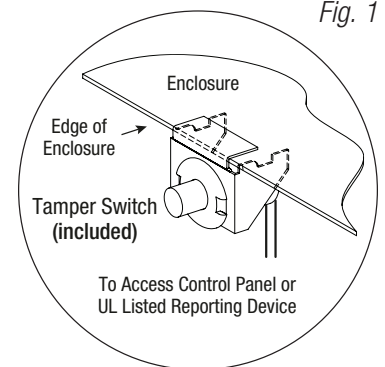

## T1CVK34: Configuration of CDVI A22K/A22NB/ADH10 Boards

1. Fasten spacers (supplied with A22K/A22NB/ADH10) to CDVI A22K/A22NB/ADH10 board (Fig. 2b, pg. 3).
2. Mount CDVI A22K/A22NB/ADH10 boards into the correct positions (Fig. 2, pg. 3) by positioning spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (Fig. 2a, 2b, pg. 3).

**Note:** CDVI A22K/A22NB/ADH10 boards have one (1) RJ45 jack each.

Please make sure that they are mounted correctly, as shown in Fig. 2 below.

3. Fasten backplane to Trove2 enclosure utilizing pan head screws (provided).

Fig. 2

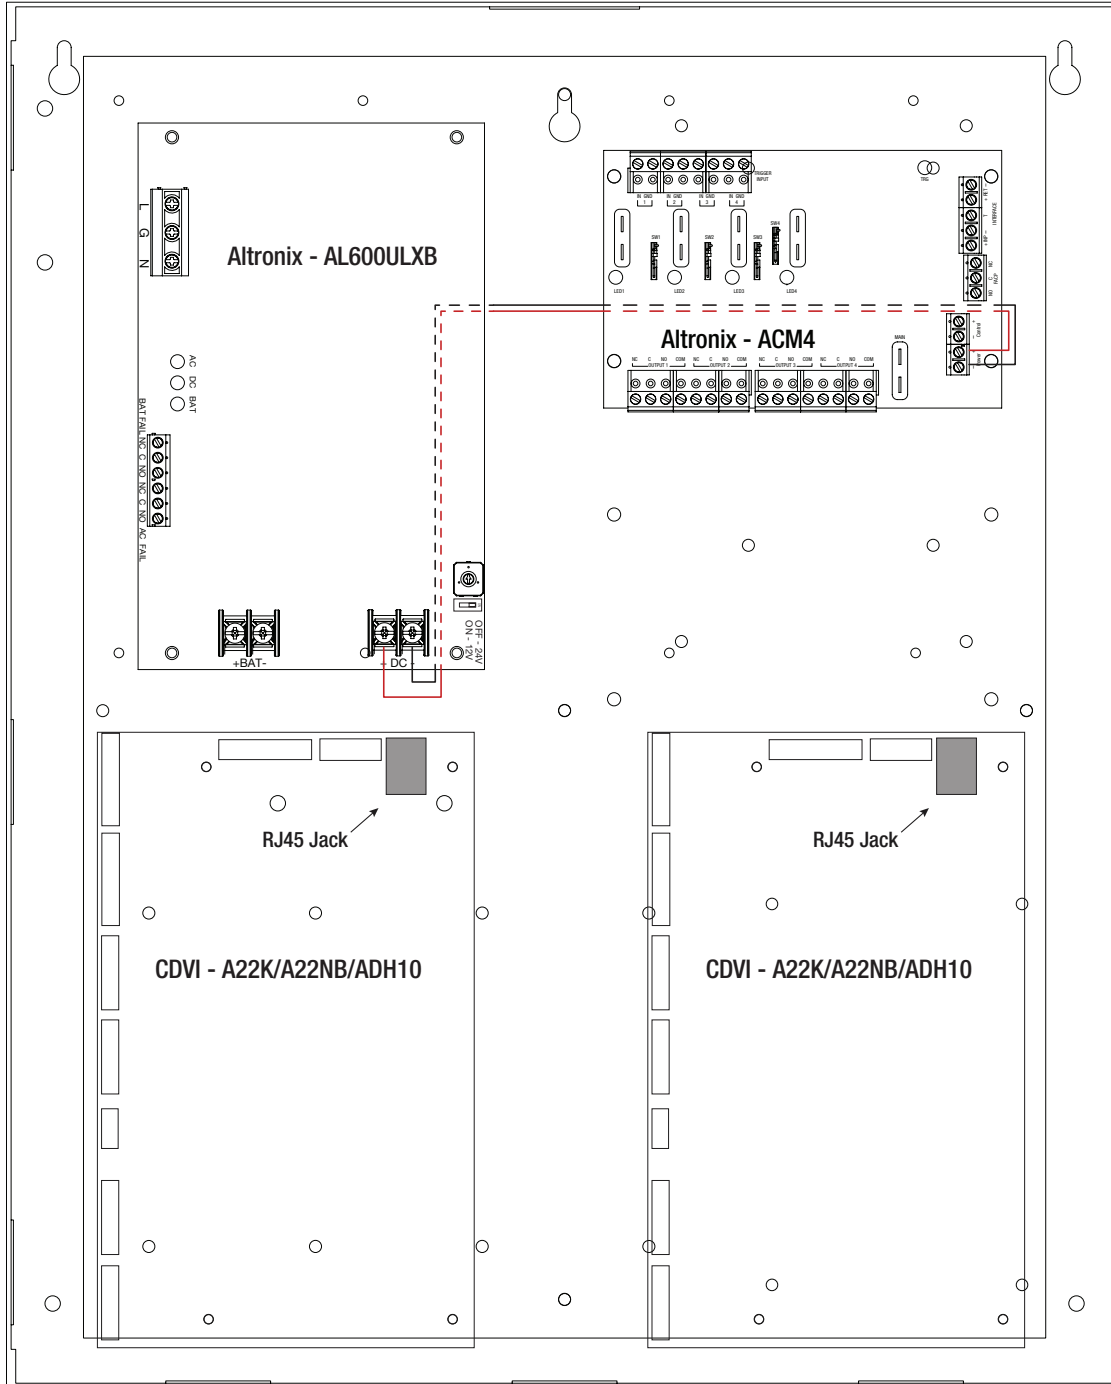


Fig. 2a


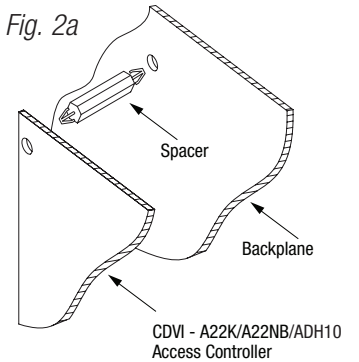


Fig. 2b

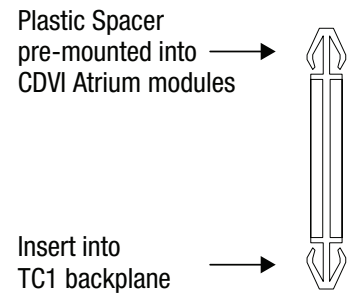

## T2CVK710: Configuration of CDVI A22K/A22NB/ADH10 Boards

1. Fasten spacers (supplied with A22K/A22NB/ADH10) to CDVI A22K/A22NB/ADH10 board (Fig. 3b, pg. 4).
2. Mount CDVI A22K/A22NB/ADH10 boards into the correct positions (Fig. 3, pg. 4) by positioning spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (Fig. 3a, 3b, pg. 4).

**Note:** CDVI A22K/A22NB/ADH10 boards have one (1) RJ45 jack each.

Please make sure that they are mounted correctly, as shown in Fig. 3 below.

3. Fasten backplane to Trove2 enclosure utilizing pan head screws (provided).

Fig. 3

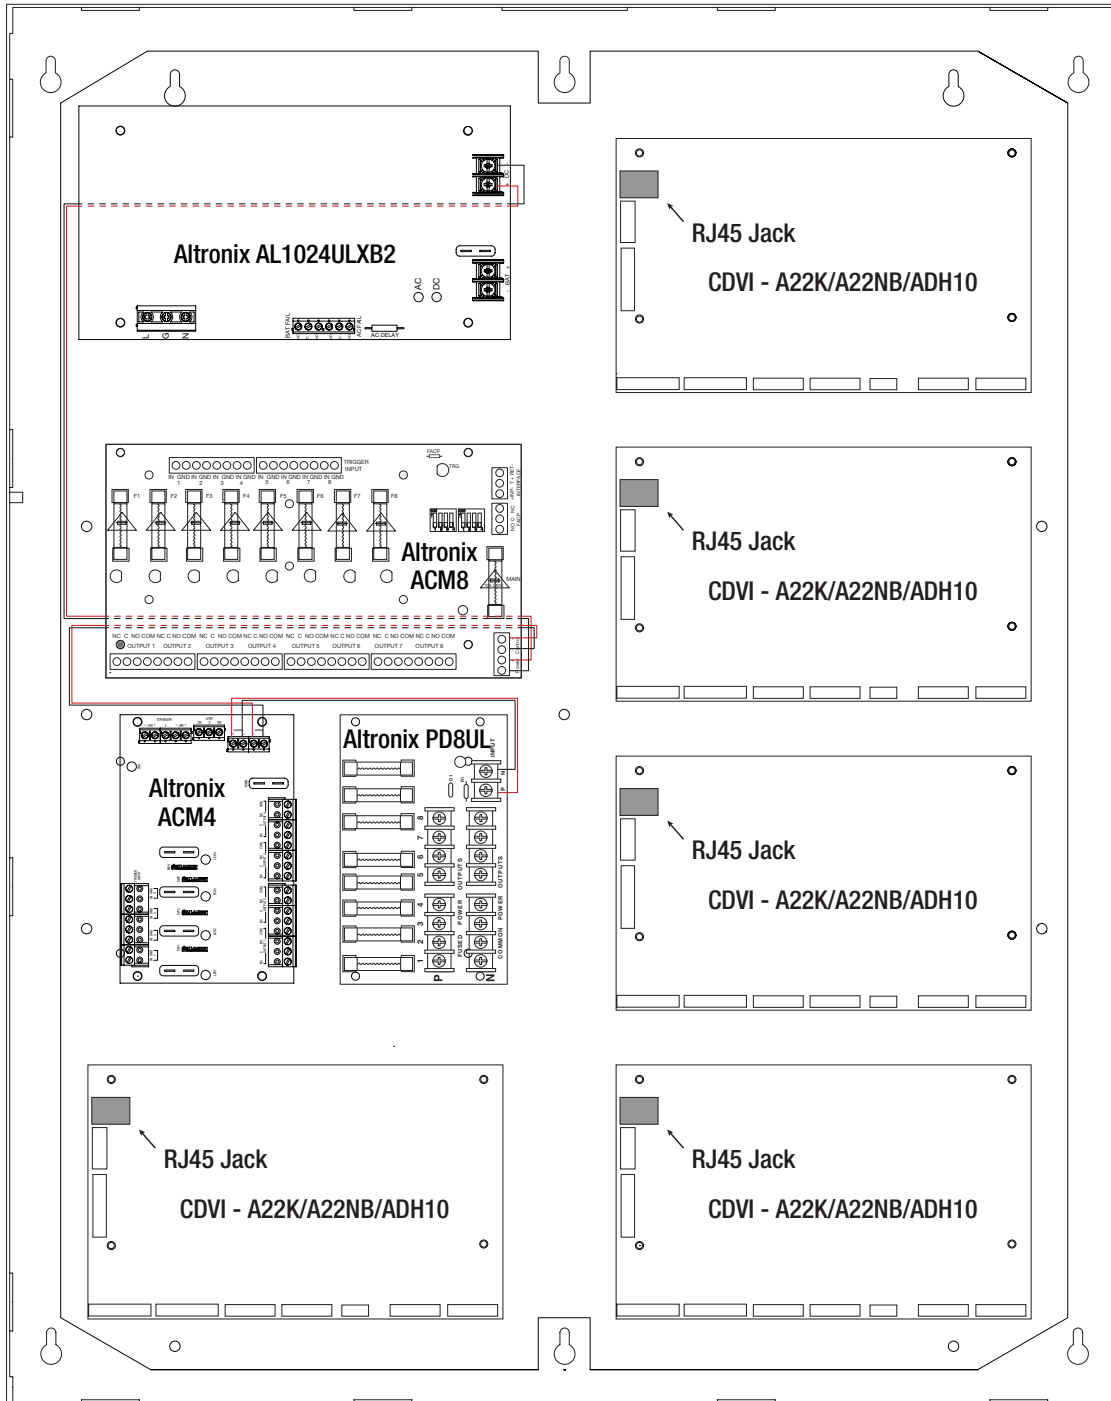


Fig. 3a


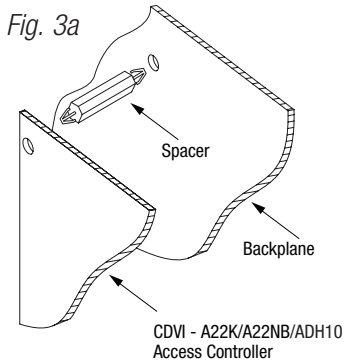


Fig. 3b

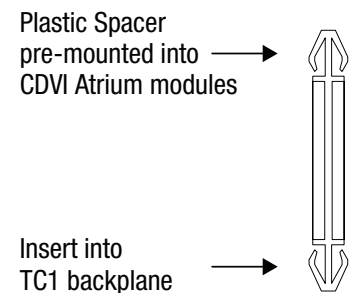

## T2CVK3310: Configuration of CDVI A22K/A22NB/ADH10 Boards

1. Fasten spacers (supplied with A22K/A22NB/ADH10) to CDVI A22K/A22NB/ADH10 board (Fig. 4b, pg. 5).
2. Mount CDVI A22K/A22NB/ADH10 boards into the correct positions (Fig. 4, pg. 5) by positioning spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (Fig. 4a, 4b, pg. 5).

**Note:** CDVI A22K/A22NB/ADH10 boards have one (1) RJ45 jack each.

Please make sure that they are mounted correctly, as shown in Fig. 4 below.

3. Fasten backplane to Trove2 enclosure utilizing pan head screws (provided).

Fig. 4

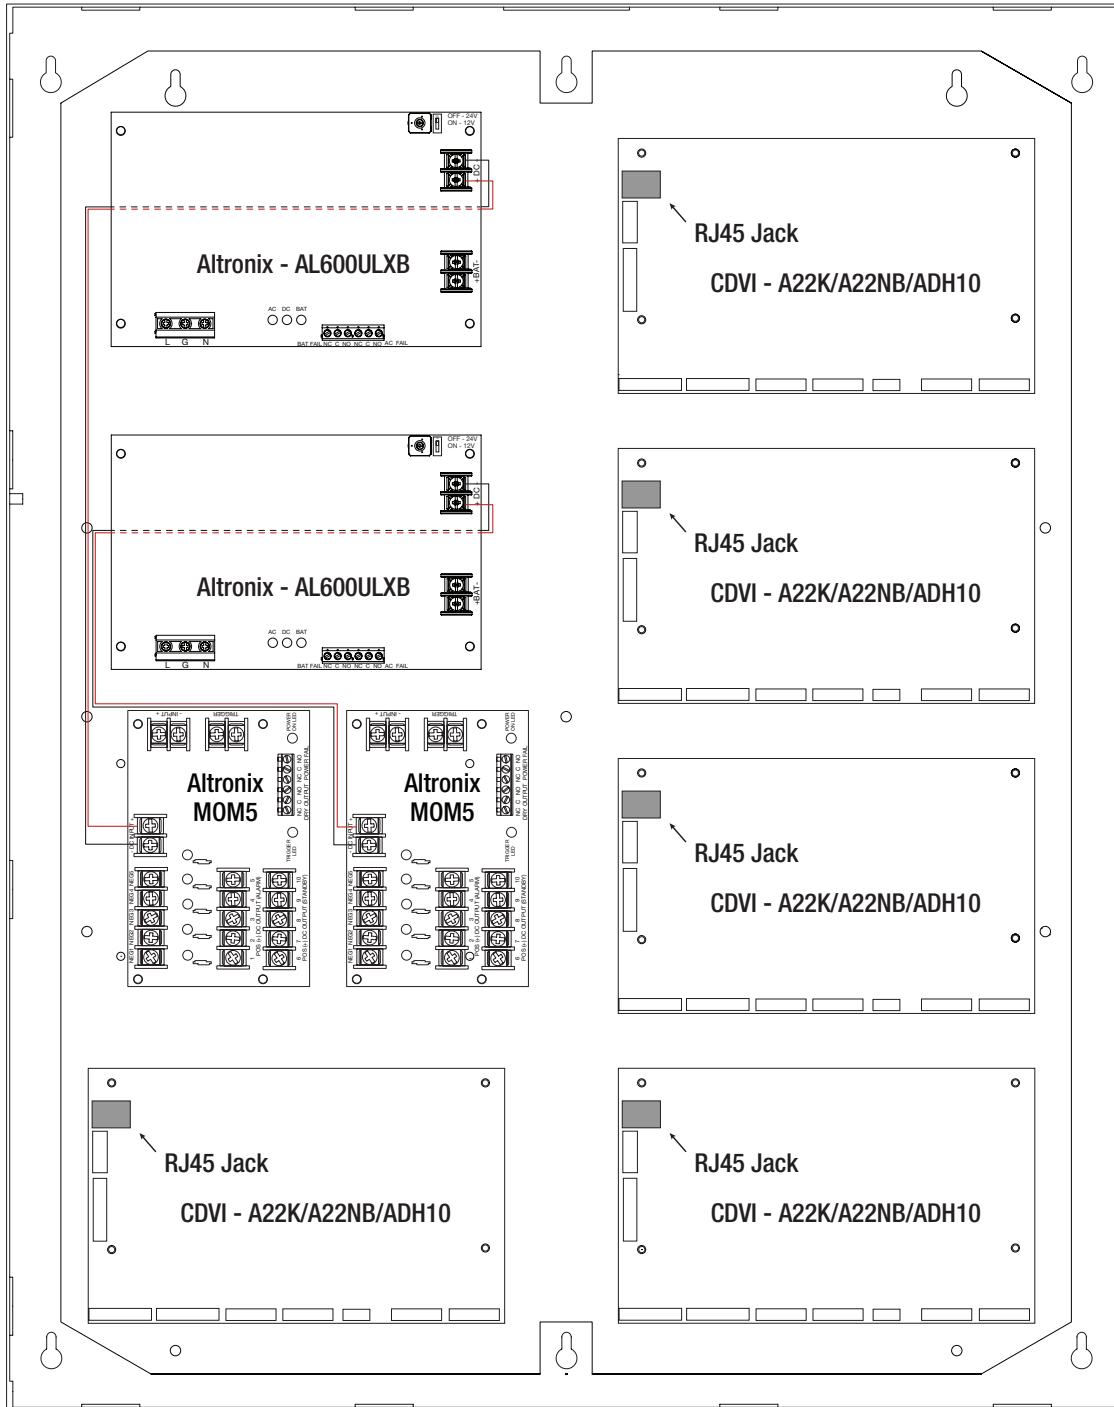


Fig. 4a

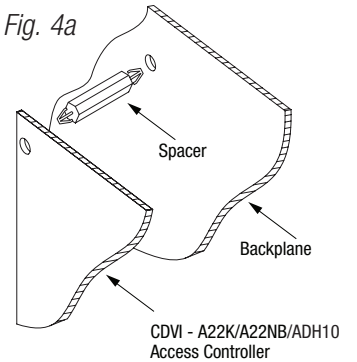


Fig. 4b

Plastic Spacer  
pre-mounted into  
CDVI Atrium modules



Insert into  
TC1 backplane



## T3CVK7720: Configuration of CDVI A22K/A22NB/ADH10 Boards




1. Fasten spacers (supplied with A22K/A22NB/ADH10) to CDVI A22K/A22NB/ADH10 board (Fig. 5b, pg. 6).
2. Mount CDVI A22K/A22NB/ADH10 boards into the correct positions (Fig. 5, pg. 6) by positioning spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (Fig. 5a, 5b, pg. 6).

**Note:** CDVI A22K/A22NB/ADH10 boards have one (1) RJ45 jack each.

Please make sure that they are mounted correctly, as shown in Fig. 5 below.


3. Fasten backplane to Trove3 enclosure utilizing pan head screws (provided).

Fig. 5

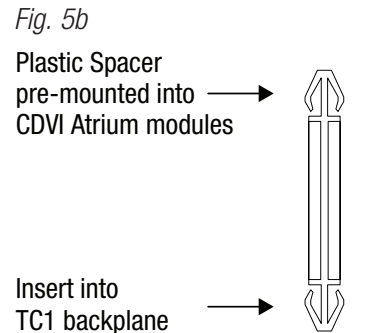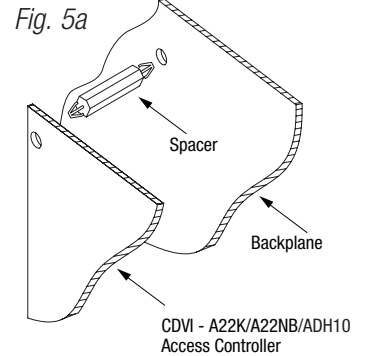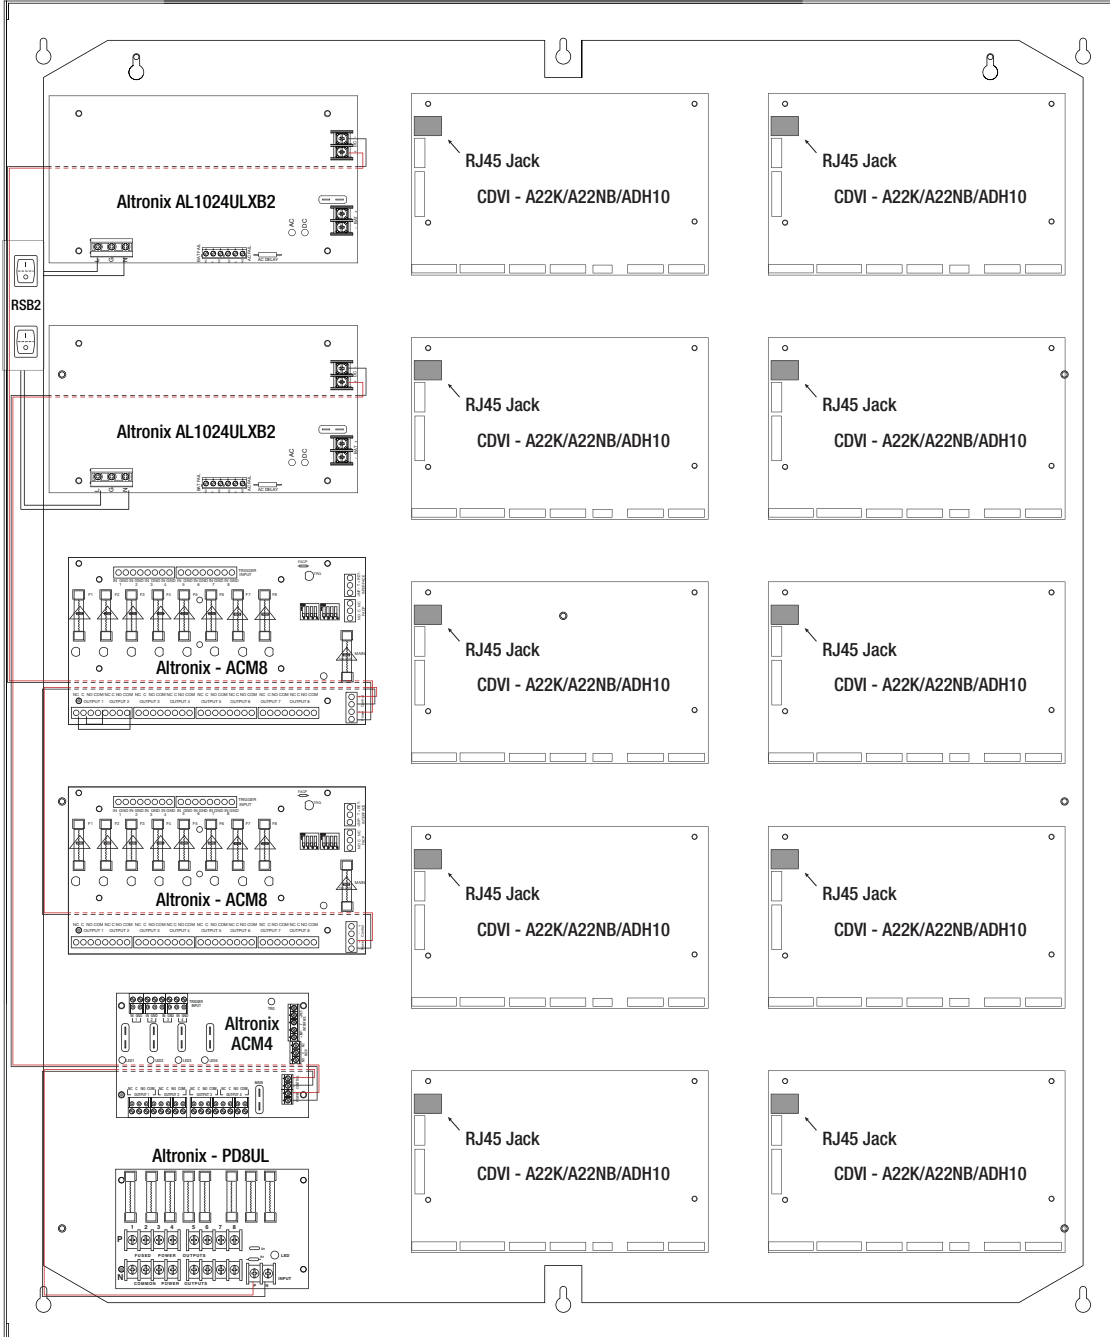


# T1CVK34 (Trove1) Enclosure Dimensions (H x W x D approximate):

18" x 14.5" x 4.625" (457mm x 368mm x 118mm)

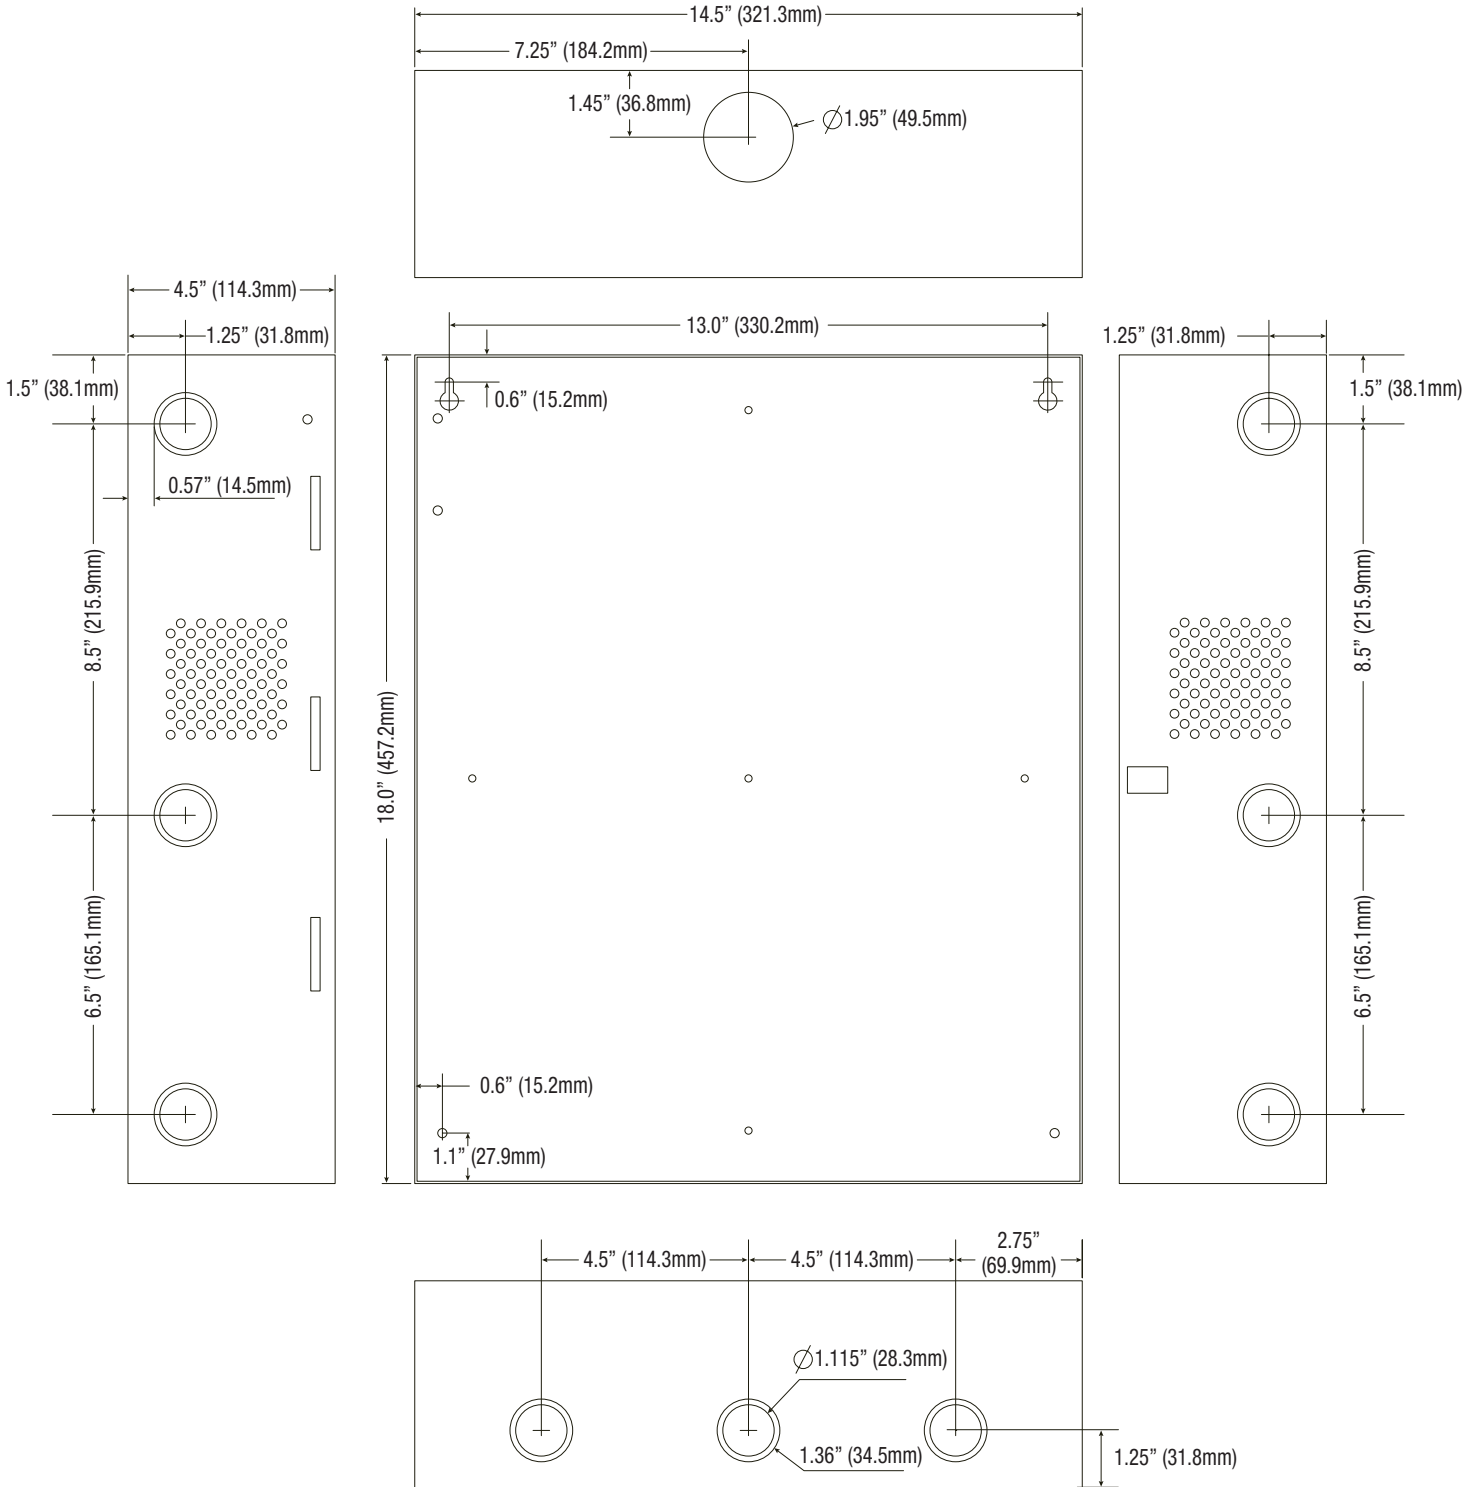

# T2CVK710 and T2CVK3310 (Trove2) Enclosure Dimensions (H x W x D approximate):


27.25" x 21.5" x 6.5" (692.2mm x 552.5mm x 165.1mm)

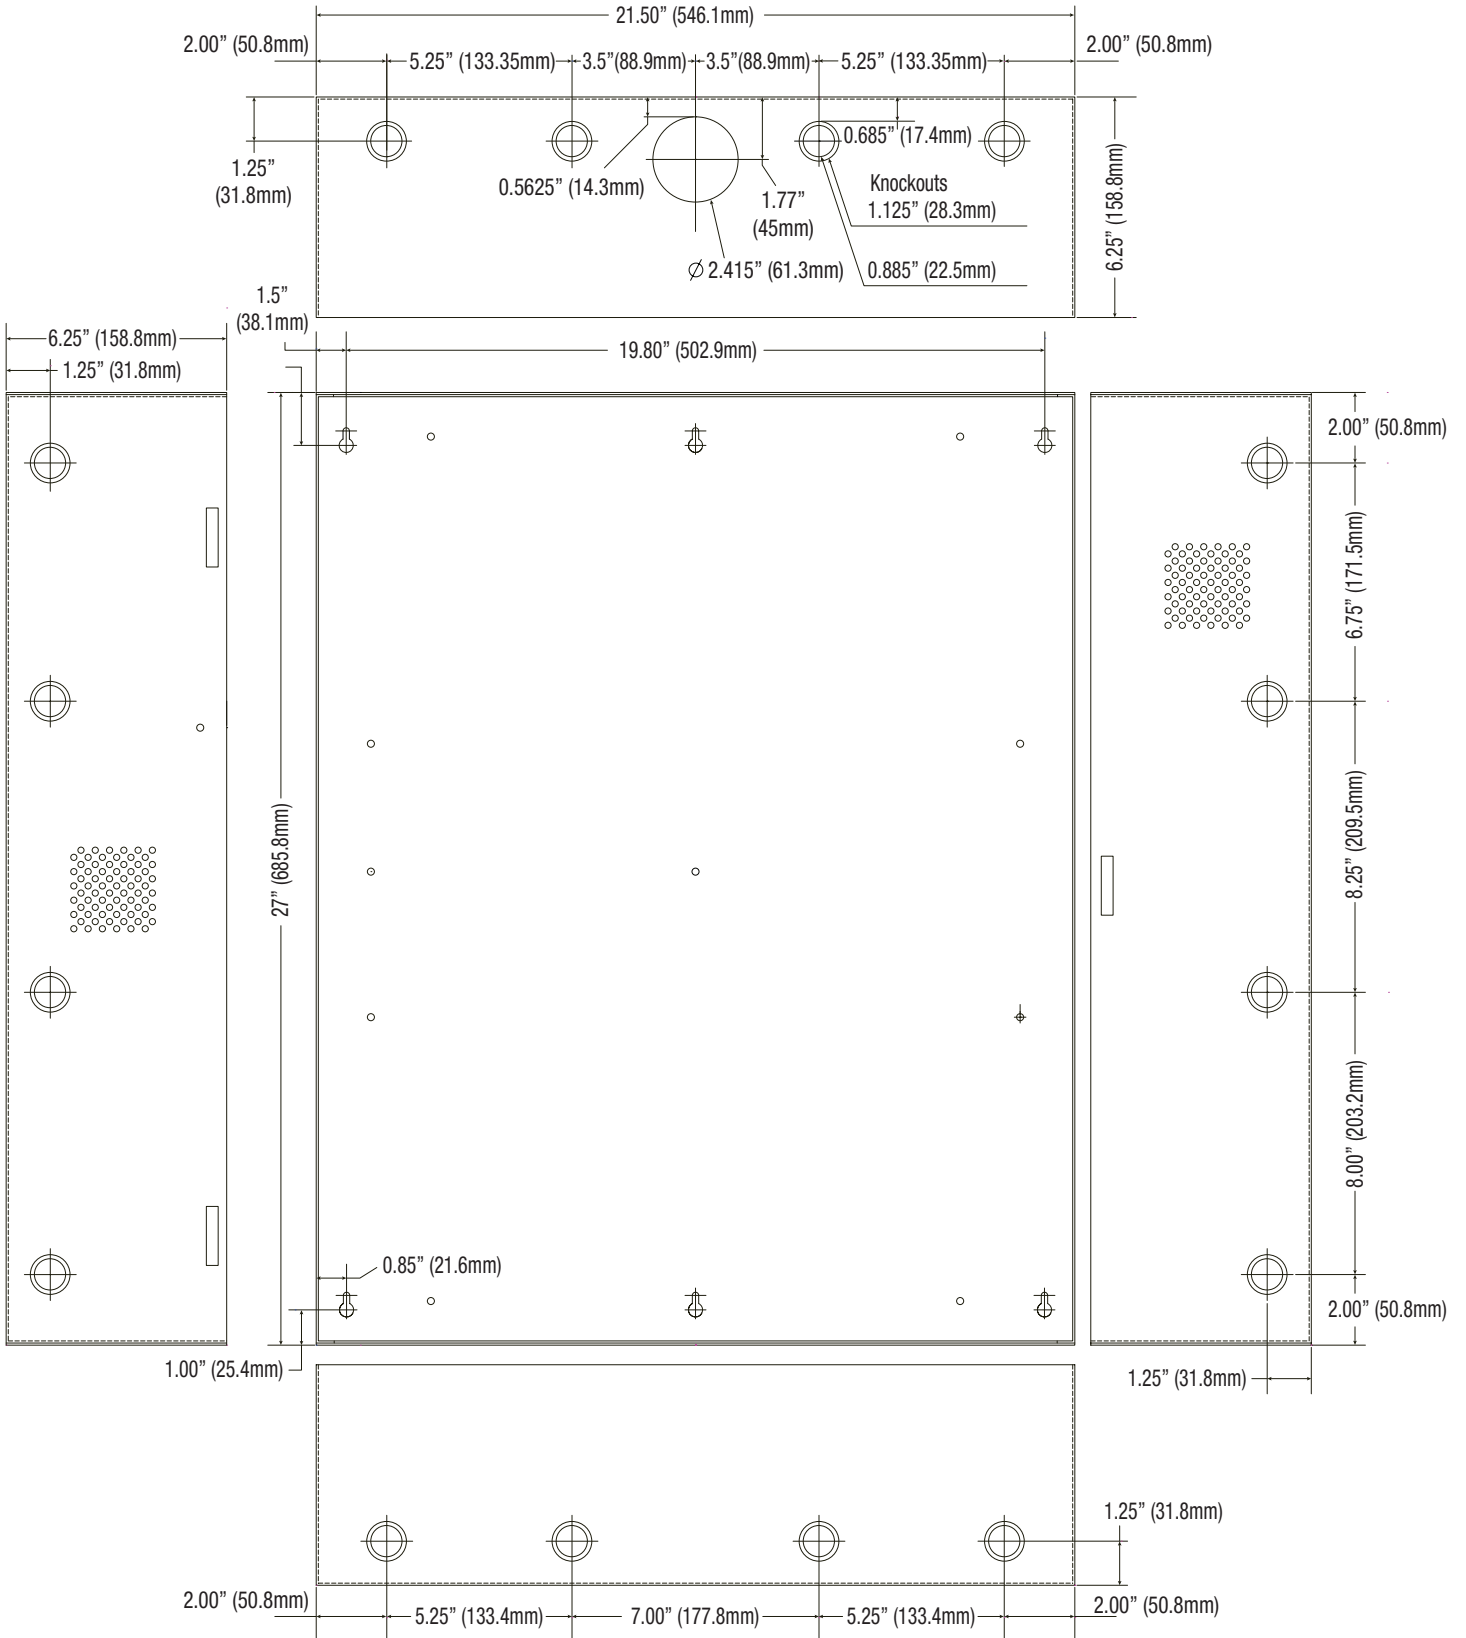



# T3CVK7720 (Trove3) Enclosure Dimensions (H x W x D approximate):

36.12" x 30.125" x 7.06" (917.5mm x 768.1mm x 179.3mm)

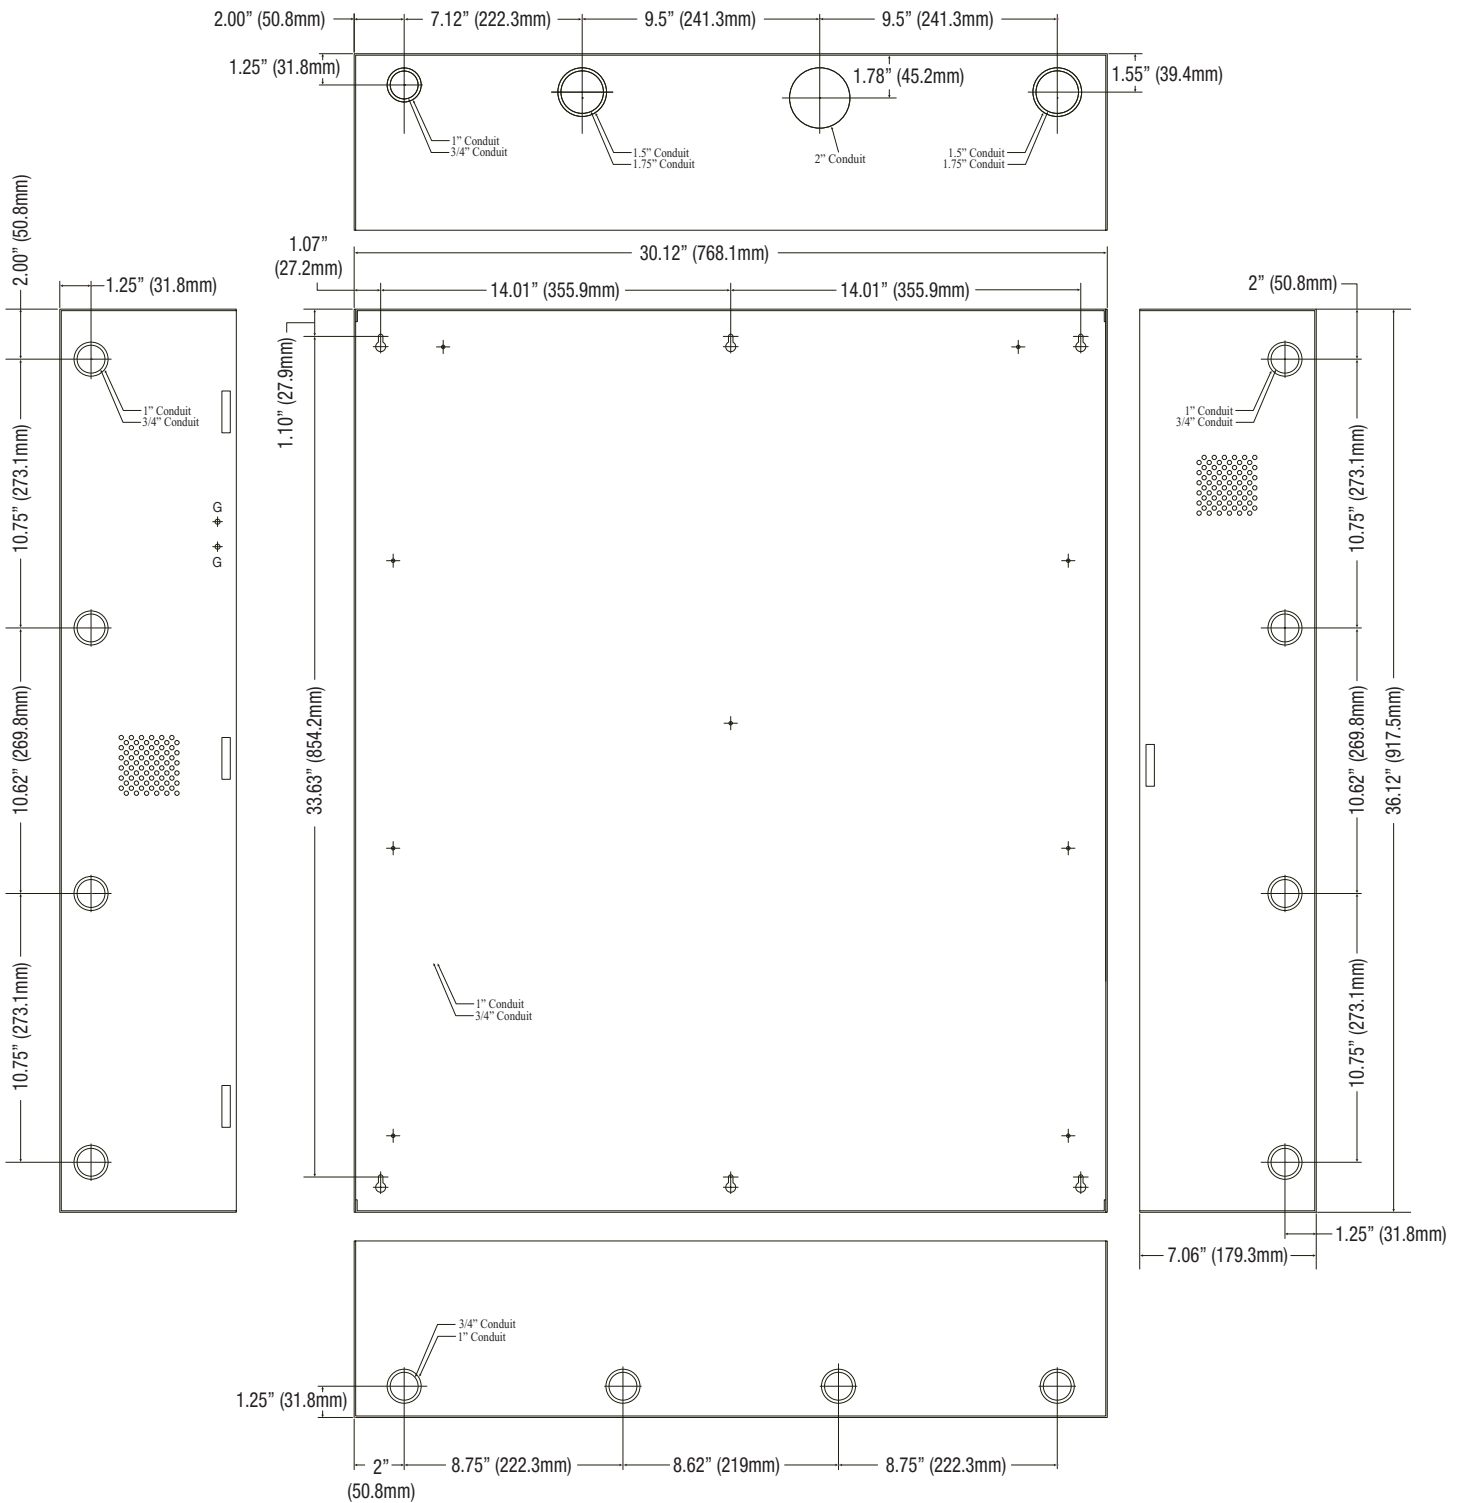

## Notes:

## Notes:

## Notes:

Altronix is not responsible for any typographical errors.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056  
web site: [www.altronix.com](http://www.altronix.com) | e-mail: [info@altronix.com](mailto:info@altronix.com) | Lifetime Warranty  
II Trove CDVI ULXB Kits

D29V



**MEMBER**