

GENERAL INSTALLATION GUIDE FLOOR MODELS

MODEL SIZE	LER SERIES	LSER SERIES	LGR SERIES	LSGR SERIES	LGNR SERIES	LGVR SERIES	LGTR SERIES
18 U	X						
21 U	X						
24 U	X		X				
35 U	X	X	X				
40 U	X	X	X	X	X	X	
44 U	X	X	X	X	X	X	
54 U							X


MAXIMUM LOADS RELATIVE FOR ALL SERIES: 3150 LBS

EQUIPMENT LOADING GENERAL:
TO MAXIMIZE INTERNAL LOAD AREA IN RACK POSITION MOUNTING RAILS AT FULL EXTENSION.

IT IS RECOMMENDED THAT ALL RACK MOUNTED GEAR BE SUPPORTED IN BOTH THE FRONT AND THE REAR.

ANCHORING REQUIREMENTS GENERAL:
ALL MODELS ARE REQUIRED TO BE SECURED TO THE FLOOR USING FASTENERS THROUGH THE FOUR(4) BOTTOM CORNER MOUNTING HOLES IN THE RACK DESIGNATED "A".

ALL FASTENERS AND ANCHORING METHODS TO BE SPECIFIED BY SITE ENGINEERS/INSPECTORS AS REQUIRED

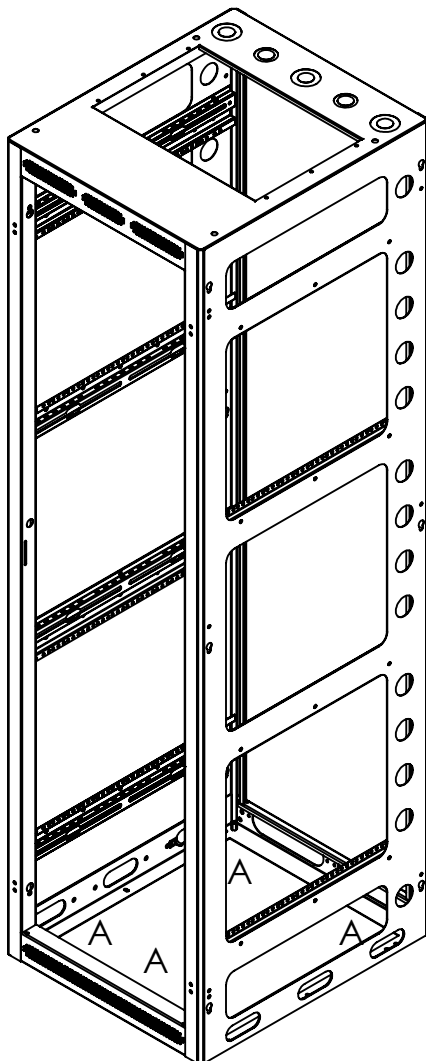

1. "THE EQUIPMENT SHALL BE INSTALLED OR SERVICED BY TRAINED SERVICE PERSONNEL IN ACCORDANCE WITH THE APPLICABLE REQUIREMENTS OF THE NATIONAL ELECTRIC CODE, ANSI/NFPA 70 OR CANADIAN ELECTRIC CODE AND THE APPLICABLE SECTIONS OF ANSI C2, THE NATIONAL ELECTRICAL SAFETY CODE. THE INSTRUCTION SHALL NOT RESULT IN THE RISK OF FIRE, ELECTRIC SHOCK, OR INJURY TO PERSONS."

2. "AMBIENT TEMPERATURE - LOWELL RACKS MAXIMUM SPECIFIED OPERATING AMBIENT OF 50 DEGREE C. SO THAT THE INSTALLER IS ABLE TO DETERMINE ACCEPTABILITY OF USE OF ACCESSORIES AND COMPONENTS IN THE OPERATING STATE."