


301C-DLC CONTROLLER NETWORK EXAMPLE

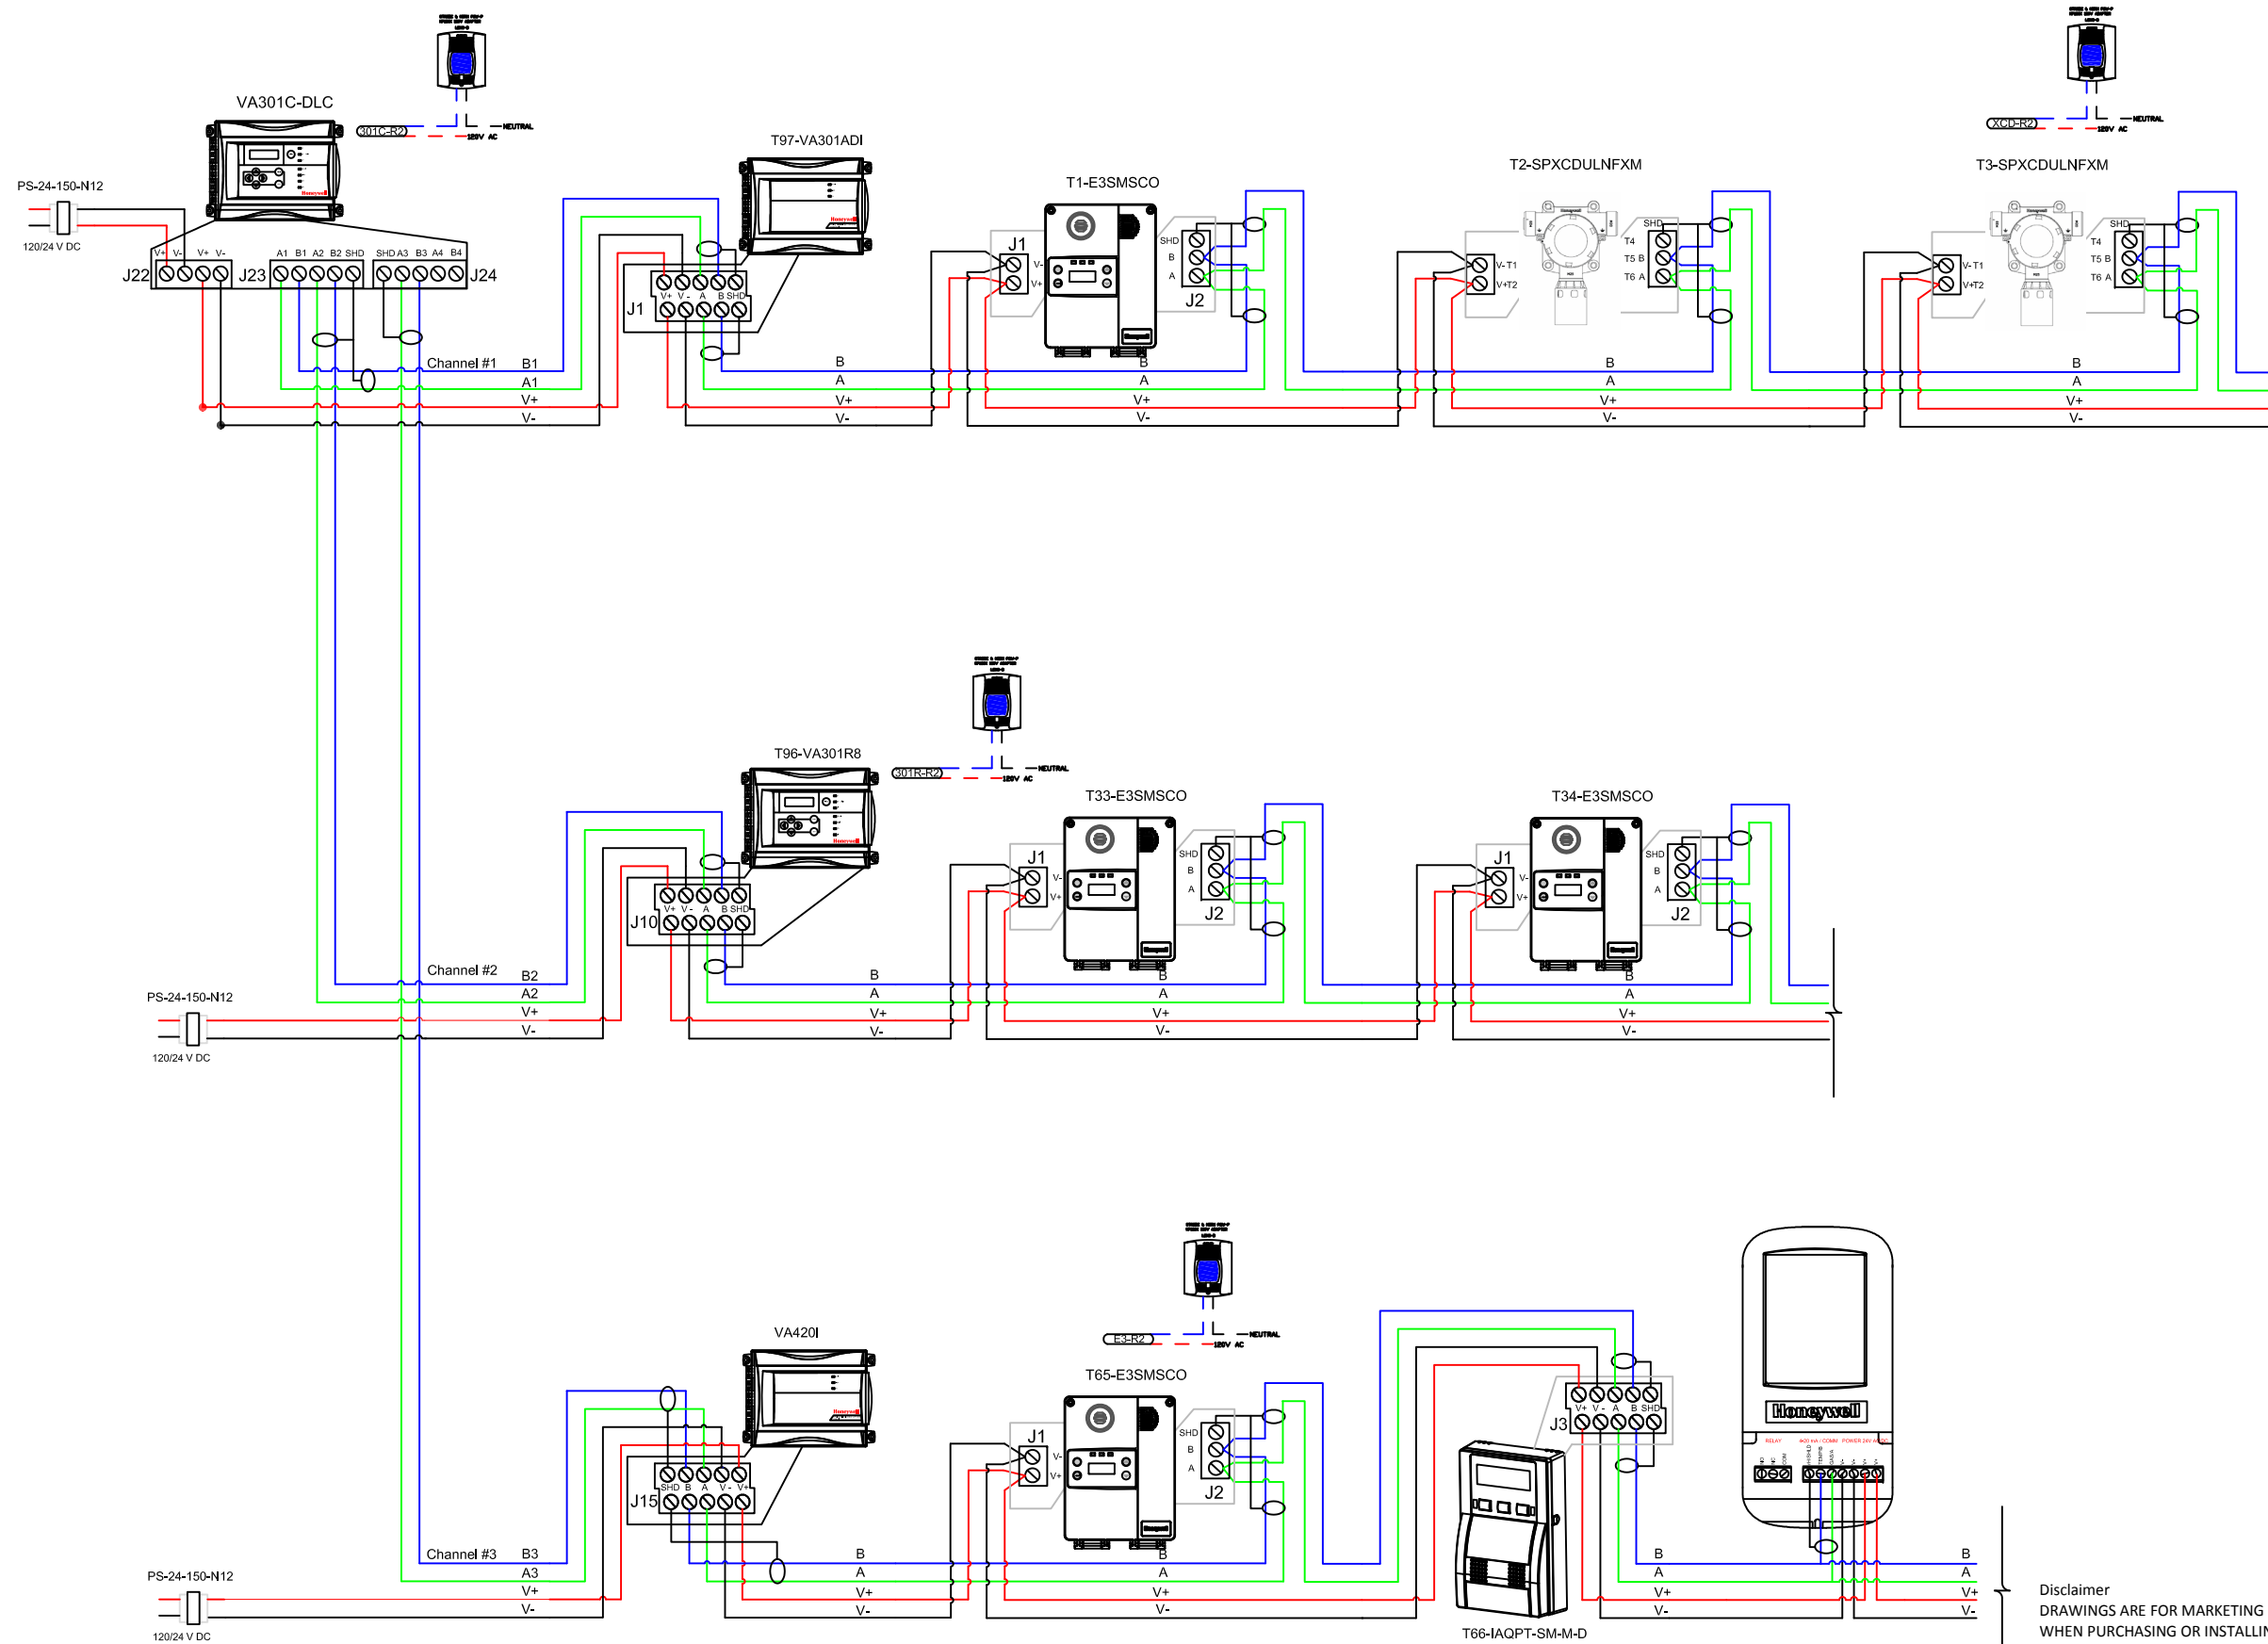

Disclaimer
 DRAWINGS ARE FOR MARKETING PURPOSES ONLY AND SHOULD NOT BE RELIED UPON BY CUSTOMER WHEN PURCHASING OR INSTALLING GAS DETECTION DEVICES. HONEYWELL IS NOT RESPONSIBLE FOR THE TYPE, SIZE, LOCATION AND SUITABILITY OF GAS DETECTION DEVICES SHOWN ON THE DRAWINGS. HONEYWELL MAKES NO CLAIM OR WARRANTY THAT THE DRAWING COMPLIES WITH LOCAL, STATE OR NATIONAL BUILDING OR SAFETY CODES. CODE COMPLIANCE IS THE SOLE RESPONSIBILITY OF THE CUSTOMER. HONEYWELL DISCLAIMS ALL WARRANTIES AND LIABILITY IN CONNECTION WITH THE DRAWING.

See the wiring details on the sheets included.
 Consult the user guide for complete information.
 The Honeywell products must be easy to access for maintenance.

| Type of gas: | | | | | |
|---------------|--|--|--|--|--|
| Alarm level A | | | | | |
| Alarm level B | | | | | |
| Alarm level C | | | | | |

| VA301C | | Wiring VA301C | | |
|----------|---------------|--|-----------|---------------|
| relay 1: | ALARM LEVEL A | Channel | Wire gage | Distance (ft) |
| relay 2: | ALARM LEVEL B | 1 | 14 AWG | 1000 |
| relay 3: | SPARE | 2 | 14 AWG | 1000 |
| relay 4: | FAULT | 3 | 14 AWG | 1000 |
| | | Communication Wire Gauge: 24-2 AWG (Belden 9841) Twisted and shielded cable 2000 feet (600 m) per channel NOTE: CONDUIT ENTRIES ARE LOCATED AT THE BOTTOM OF THE ENCLOSURES. | | |

| | |
|-----------------|---------------------------|
| Project: | 301C-DLC NETWORK EXAMPLES |
| Client: | |
| Drawing number: | |
| Rev. | Date: OCT 16, 2012 |
| Drawn by: | SJI |
| # Command: | N/A |
| | Page: (1/1) |

Honeywell 405 Barclay Boulevard
 Analytics Lincolnshire, IL 60069
 Tel.: 1-800-563-2967
 Fax.: 1-888-967-9938
 www.honeywellanalytics.com