


INSTALLATION



dormakaba Group

906, 908, 916, 919, 920 MUSHROOM CAP PUSHBUTTONS

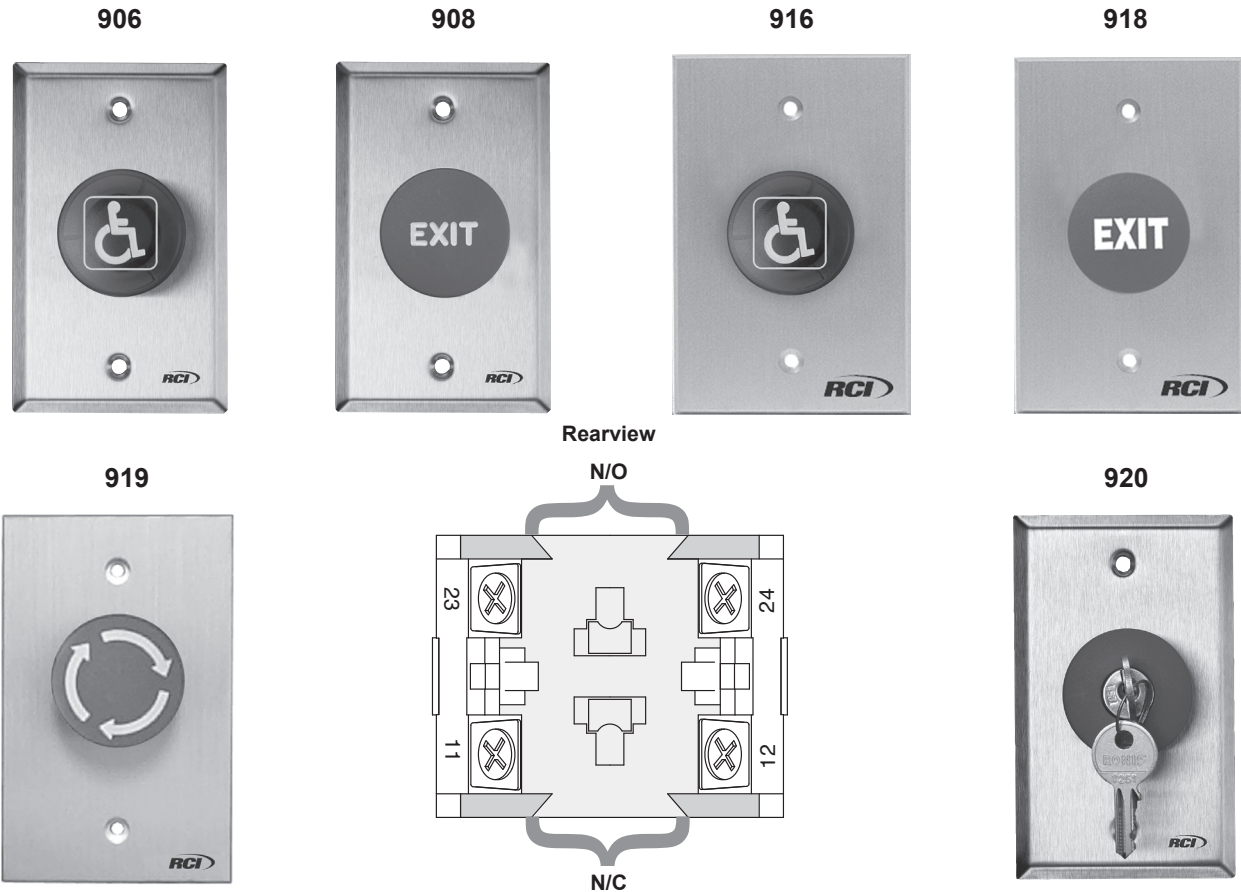

| Description | Switch Mode | Switch Configuration | Switch Rating | Standard |
|-----------------------|----------------------------|---------------------------|---------------------|-------------------|
| 906-MO Handicap | Momentary Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 32D Blue Cap |
| 906-TD Handicap | Adj. Delay 1 sec - 34 hrs* | DPDT N/O & N/C | Timer rated 5A @24V | 32D Blue Cap |
| 906-MA Handicap | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 32D Blue Cap |
| 908-MO Exit Button | Momentary Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 32D Red Cap |
| 908-TD Exit Button | Adj. Delay 1 sec - 34 hrs* | DPDT N/O & N/C | Timer rated 5A @24V | 32D Red Cap |
| 908-MA Exit Button | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 32D Red Cap |
| 916-MO Handicap | Momentary Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 28 or 40 Blue Cap |
| 916-TD Handicap | Adj. Delay 1 sec - 34 hrs* | DPDT N/O & N/C | Timer rated 5A @24V | 28 or 40 Blue Cap |
| 916-MA Handicap | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 28 or 40 Blue Cap |
| 918-MO Exit Button | Momentary Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 28 or 40 Red Cap |
| 918-TD Exit Button | Adj. Delay 1 sec - 34 hrs* | DPDT N/O & N/C | Timer rated 5A @24V | 28 or 40 Red Cap |
| 918-MA Exit Button | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 28 or 40 Red Cap |
| 919-MA Rotary Release | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 28 or 40 Red Cap |
| 920-MA Key Release | Maintained Action | 1 x SPST N/O & 1 SPST N/C | 6A @24V cULus | 32D Red Cap |

*Mounted separately. N/C – Normally Closed; N/O – Normally Open **NOTE:** Specifications are subject to change without notice.