



# OPTICA INTELLIGENT DUCT SMOKE DETECTOR ROTARY ADDRESSED KIR-DDOS



## OVERVIEW

The Kidde Intelligent Rotary Duct Smoke Detector is the most advanced and most reliable device in its class. Designed for easy installation and superb reliability, Optica duct detectors represent the perfect balance of practical design, advanced technology and robust performance.

**Optica duct detectors** feature a unique design that speeds installation and simplifies maintenance. Separate sensing and control sections, optical sensing tube, conformally coated circuit boards and hydrophilic coatings keep contaminants away from sensitive electronics providing longer service life. When cleaning is required, the assemblies come apart easily and snap back together in seconds.

The optical sensing tube incorporates many of the same principles used in the Optica detector. This sensor inherits the power and benefits of this exceptional technology.

Optica duct sensors gather analog information from their smoke sensing elements and convert it into digital signals. The sensor measures and analyzes these signals and compares the information to historical readings and time patterns to make an alarm decision. Digital filters and algorithms remove signal patterns that are not typical of fires, which reduces unwanted alarms.


**WARNING:** Duct detectors have specific limitations. Duct detectors are not a substitute for an open area smoke detector. Duct detectors are not a substitute for early warning detection or a replacement for a building's regular fire detection system. Smoke detectors are not designed to detect toxic gases which can build up to hazardous levels in some fires. These devices will not operate without electrical power. As fires frequently cause power interruptions, Kidde Commercial suggests you discuss further safeguards with your local fire protection specialist.

## STANDARD FEATURES

- Less than 2.5" deep for easy installation and applications where space is tight
- -20°F to 158°F (-29°C to 70°C) operating range with 100 ft/min to 4,000 ft/min air velocity rating assures reliability under harsh environmental conditions
- Standard sampling tube spacing for easy drop-in migration from other detectors
- Sampling tube can be installed with or without the cover/sensor in place and can be rotated in 45-degree increments to ensure proper alignment with duct airflow
- 15.2 to 19.95 Vdc operation
- Magnet-activated test switch
- One Form C auxiliary alarm relay for controlling ancillary equipment (e.g., HVAC controls)
- No special tools required for easy access to field connections
- 1-127 rotary switch addressing
- Environmental compensation with differential sensing for reliable, stable, and drift-free sensitivity
- Wide 1.5% to 4.5% obscuration/ft. smoke sensitivity
- Identification of dirty or defective detectors

## APPLICATION

Optica duct detectors are ideally suited to duct smoke detection applications where early indication of combustion is required within the confined space of ventilation ductwork. Its primary purpose is to provide early warning of an impending fire and to prevent smoke from circulating throughout the building. It is typically used to detect smoke in the supply side of the HVAC system but can provide sensing of the return side as well.

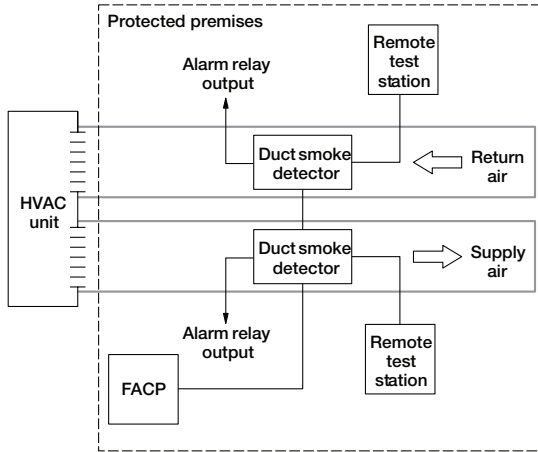

Optica duct detectors continually sample air flow in the HVAC duct and initiate an alarm condition whenever smoke is detected. An alarm is activated when the quantity (percent obscuration) of combustion products in that air sample exceeds the detector's sensitivity setting.

### Kidde Intelligence

The Kidde Intelligent KIR-DDOS features electronic addressing and issues a dirty sensor warning when it reaches its preset limit. The dirty sensor warning indicates the sensor is operating within its specified limits but is in need of servicing. When the detector's ability to compensate for environmental changes has reached its limit, the duct smoke detector signals a trouble condition.

The KIR-DDOS also uses differential sensing to prevent gradual environmental changes from triggering unwanted alarms. A rapid change in environmental conditions, such as smoke from a fire, causes the detector to signal an alarm state, but dust and debris accumulated over time does not change alarm sensitivity.

Each KIR Optica duct detector contains a microprocessor that performs comprehensive self-diagnostics and stores the results in nonvolatile memory. Stored results include details such as hours of operation, last maintenance date, and number of alarms and troubles. This information can be retrieved and reviewed when desired.

### Detector Configuration

The detector assembly cover provides easy access to the smoke sensor, its wiring connections, sample and exhaust tubes, and the smoke chamber itself.

Air enters the detector's sensing chamber through a sampling tube (ordered separately) that extends into the duct and is directed back into the ventilation system through an exhaust tube (included). The difference in air pressure between the two tubes pulls the sampled air through the sensing chamber. When a sufficient amount of smoke is detected in the sensing chamber, the detector initiates an alarm.

The sampling tube may be installed from either the duct side of the assembly or from inside the sensor compartment, as preferred by the installer. (The exhaust tube must be installed from the duct side.) Sampling tubes may be rotated in 45-degree increments so that air holes can be aligned to allow the unit to be mounted at virtually any angle relative to the air flow.

In installations where the duct smoke detector's controls and indicators are hidden from view, a remote test station or an LED indicator can be connected to the detector to provide these functions.

### Remote Test Stations




Labor-saving Remote Test/Reset stations provide alarm testing from the convenience of a remote location. Tests can be performed quickly and safely – without having to climb to the roof. Magnetically operated and key-operated one-gang models are available. Kidde Optica duct detectors are also compatible with GSA-LED remote alarm LED.

Air velocity in the duct as low as 100 ft/min. maintains adequate air flow into the sensor smoke chamber through air holes in the air sampling tube and discharges through the exhaust tube. Optica duct air sampling tubes must be installed with the inlet holes facing the airstream. Sampling tubes may be rotated in 45-degree increments so that air holes can be aligned to allow the unit to be mounted in virtually any angle relative to the airflow.


Optica duct sensors are engineered to operate optimally under the harsh environmental conditions frequently found in HVAC ductwork. Nonetheless, before installing the detector, test the duct air velocity, temperature, and humidity to verify that it is within the operating range of the Optica duct detector. Consult the Optica duct installation sheet for details.

## DIMENSIONS

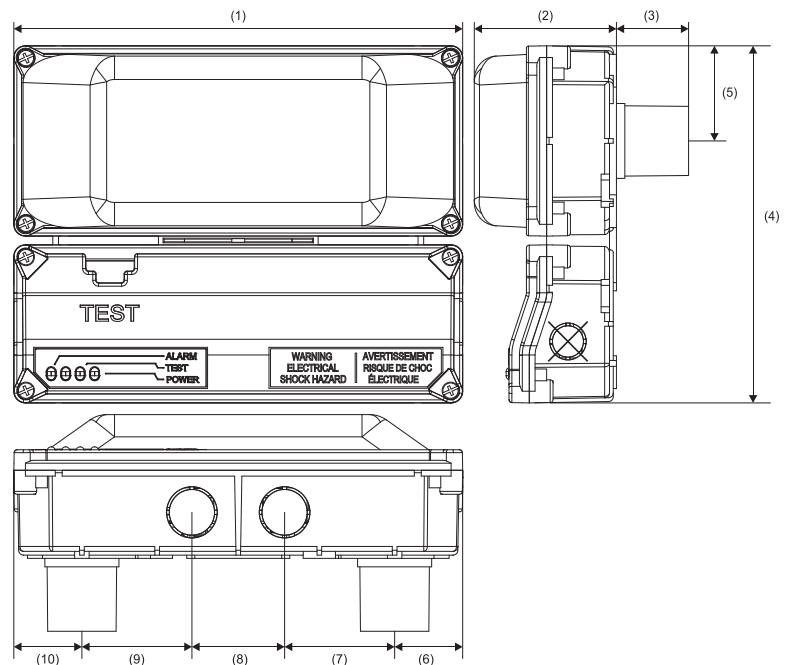


(1) 7.75 in. (16.69 cm)	(4) 6.10 in. (15.49 cm)	(6) 1.175 in. (2.98 cm)	(9) 1.90 in. (4.83 cm)
(2) 2.50 in. (6.35 cm)	(5) 1.63 in. (4.14 cm)	(7) 1.90 in. (4.83 cm)	(10) 1.175 in. (2.98 cm)
(3) 1.25 in. (3.18 cm)		(8) 1.60 in. (4.06 cm)	

## ASSEMBLY

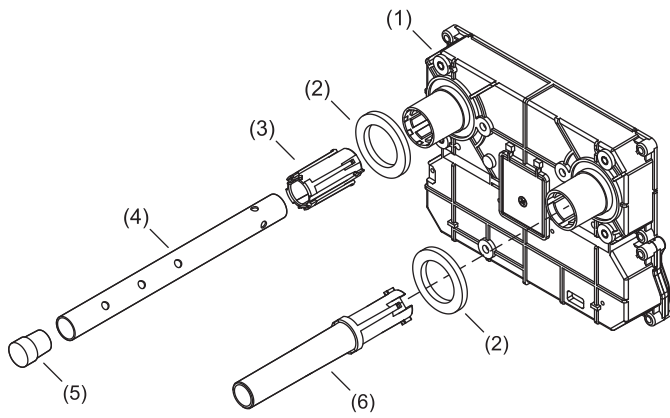


- (1) Duct smoke detector
- (2) Gasket (2X)
- (3) Sampling tube coupling
- (4) Sampling tube (ordered separately)
- (5) Cap plug
- (6) Exhaust tube

## MOUNTING

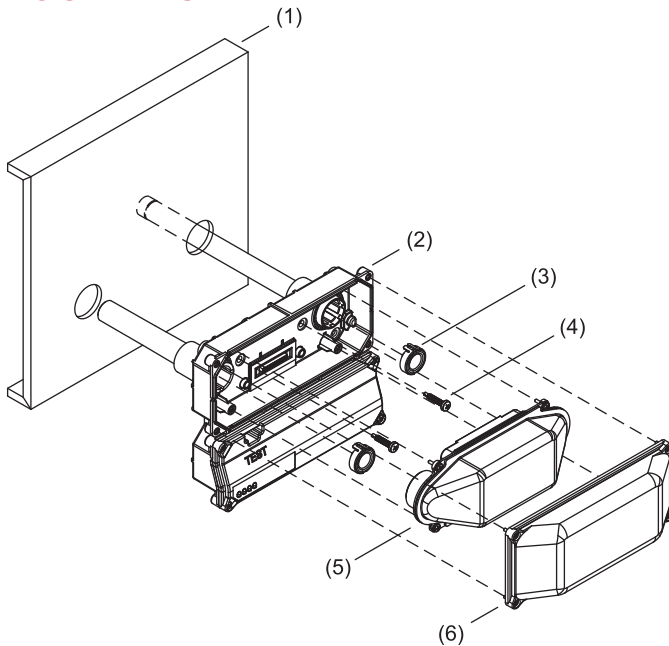

- (1) HVAC duct
- (2) Duct smoke detector
- (3) Bug screens (2X) (optional)
- (4) Mounting screws (2X)
- (5) Optica tube assembly
- (6) Optica tube assembly cover


## WIRING

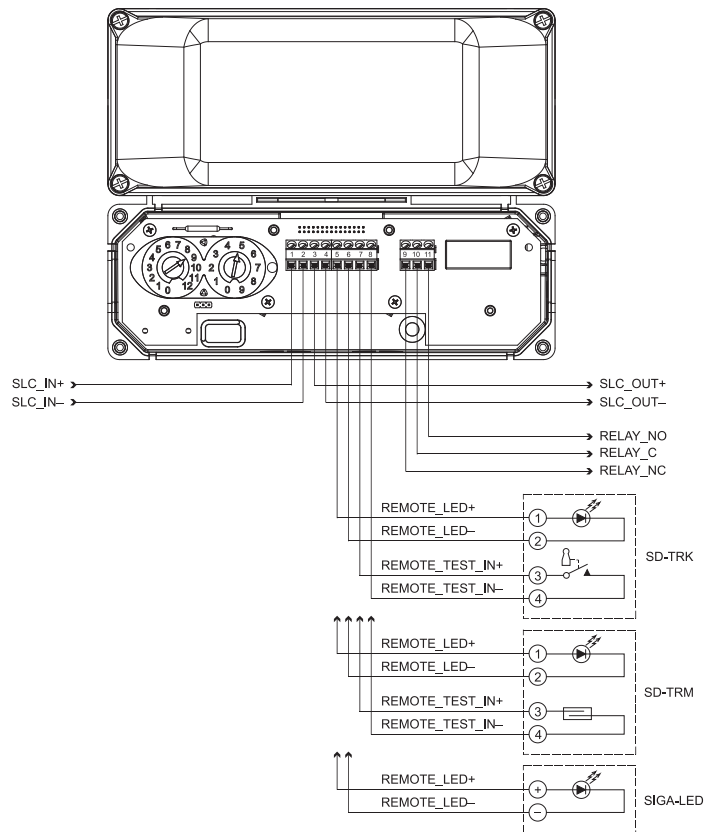

### Terminal block detail

Number	Signal name	Number	Signal name
1	SLC_IN+	7	REMOTE_TEST_IN+
2	SLC_IN-	8	REMOTE_TEST_IN-
3	SLC_OUT+	9	RELAY_NC
4	SLC_OUT-	10	RELAY_C
5	REMOTE_LED+	11	RELAY_NO
6	REMOTE_LED-		

KIR-DDOS duct smoke detectors are manually addressable. The address switches are on the interface board.

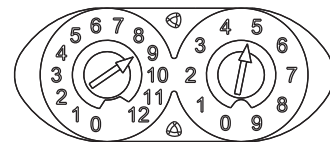

To set the address switches, use a small screwdriver to set the TENS rotary switch (0 through 12) for the 10s and 100s digit, and the ONES rotary switch for 0 through 9. For example, for a device address of 21, set the TENS rotary switch to 2 and set the ONES rotary switch to 1.

## SPECIFICATIONS, DETECTOR

Dimensions	7.75 x 6.1 x 2.5 inches (167 x 155 x 65 mm)
Wire size	14 to 22 AWG
Detection method	Photoelectric (light scattering principle)
Air velocity rating	100 to 4,000 ft/min and meets the required minimum air pressure differential
Air pressure differential	0.01 to 0.83 inch of water
Sensitivity	1.5 to 4.5%/ft obscuration
Alarm test response time	5 seconds
LED indicators	Alarm (red), Test (amber), Normal (green)
Common alarm relay	Unsupervised and power- limited Quantity: 1; Type: Form C Ratings: 3.0 A @30VDC, 3.0A @ 120VAC (.35pf), 1.5A @ 240VAC (.35pf)
Operating voltage	15.2 to 19.95 VDC
Operating current	Standby: 50 µA Alarm: 60 µA
Operating environment	Temperature (UL/ULC): -20 to 158°F (-29 to 70°C). Relative humidity: 0 to 93%, noncondensing
Agency listings	UL, ULC, CSFM
Compatible Panels	Kidde Intelligent Rotary Loop controllers
Storage temperature	-20 to 158°F (-29 to 70C)

## SPECIFICATIONS, TEST STATIONS

Remote Test/Reset Stations provide alarm test, trouble indication, and reset capability from a remote location. They include a one-gang plate, momentary SPST switch, red alarm LED, and terminal block. Magnetically operated models (TRM) or key-operated models (TRK) are available.

Compatible electrical boxes	North American 1-gang box Standard 4-in square box, 1-1/2 inches deep, with 1-gang cover
LED indicators	Alarm (red)
LED type	Clear lens
Wire size	14 to 22 AWG
Resistance per wire	10 Ohms, max.
Current requirements	See controller specifications
LED circuit ratings	Voltage: 3 VDC, max. Current: 30 mA, max.
Switch ratings (SD-TRK)	Voltage: 125 VDC, max. Current: 4 A, max.
Switch ratings (SD-TRM)	Voltage: 200 VDC, max. Current: 0.5 A, max.
Operating environment	Humidity: 93% RH, noncondensing
Storage temperature	-4 to 140°F (-20 to 70°C)
Agency listings	UL, ULC, CSFM

## CONTACT US

Phone: 888.244.9979 (Option 4)  
Email: [kidde.fire@carrier.com](mailto:kidde.fire@carrier.com)  
Website: [kidde-esfire.com](http://kidde-esfire.com)

Kidde is a Carrier brand.  
8985 Town Center Pkwy,  
Bradenton, FL 34202

©2024 Carrier.  
All rights reserved.

## ORDERING INFORMATION

Catalog	Description	Ship Wt., lb. (kg)
KIR-DDOS	Optica Duct Smoke Detector, rotary addressed	2.4 (1.1)
<b>Accessories</b>		
SD-T8	8-inch sampling tube	0.5 (0.2)
SD-T18	18-inch sampling tube	1.5 (0.7)
SD-T24	24-inch sampling tube	2.7 (1.2)
SD-T36	36-inch sampling tube	3.0 (1.4)
SD-T42	42-inch sampling tube	3.5 (1.6)
SD-T60	60-inch sampling tube	5.8 (2.6)
SD-T78	8-inch sampling tube	7.5 (3.4)
SD-T120	120-inch sampling tube	11.5 (5.2)
GSA-LED	Remote alarm LED	1.0 (0.5)
SD-TRM	Remote test station, magnetic	1.0 (0.5)
SD-TRK	Remote test station, keyed	1.0 (0.5)
KIR-DDOSIB	Replacement interface board	
KIR-DDOS-ROT	Replacement optical sensor tube assembly	
DDOS-RET	Replacement exhaust tube	
SD-VTK	Air velocity test kit (stoppers only, etc)	1.0 (0.5)
SD-MAG	Test magnet kit	0.5 (0.2)