


Call Station Wiring Clarification

Call Station IN (Port A) and OUT (Port B) Terminal Block Locations

This Technical Bulletin is provided to clarify the physical locations and the associated wiring of the IN (Port A) and OUT (Port B) terminal blocks on a Call Station.

In an effort to display a clear representation of Call Station wiring, the figure below reverses the physical locations of the Call Station's IN (Port A) and OUT (Port B) terminal blocks.

Note: *When looking at the back of the unit*, the actual physical location of the IN (Port A) terminal block is located to the right of the OUT (Port B) terminal block and not to the left as indicated below.

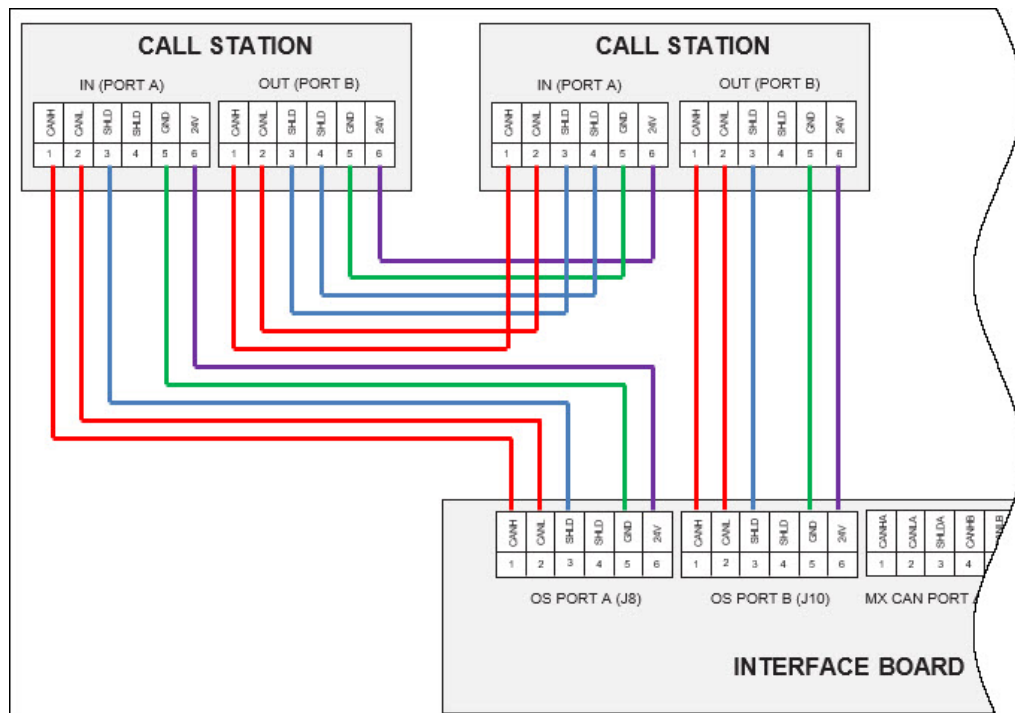

Eaton assumes no liability for damage incurred directly or indirectly from errors, omissions, or discrepancies between products and the manual. Eaton assumes no liability for damage incurred directly or indirectly from errors, omissions, or discrepancies between products and the manual. Eaton reserves the right to make changes to product specification without notice or liability..



Powering Business Worldwide

Eaton
1000 Eaton Boulevard
Cleveland, OH 44122
United States
Eaton.com

Eaton
Life safety & mass notification
solutions
273 Branch Ave.
Long Branch, NJ 07740
eaton.com/Lifesafetysolution

© 2025 Eaton
Cooper Wheelock, Inc. dba Eaton
All Rights Reserved

No patent liability is assumed with respect
to the use of the information contained
herein
Printed in USA
Publication No. P85946_A
July 2025

Eaton is a
registered trademark.

All other trademarks
are property of their
respective owners.